

April 15, 2022

Mr. Keith Moore
Carlson Consulting Engineers
7068 LedgeStone Commons
Bartlett, Tennessee 38133

Re: Geotechnical Engineering Services Report
Cottages at Generation Village
Buck Road near Megan Lane
Willard, Missouri
PSI Project Number: 03382353

Dear Mr. Moore:

Thank you for choosing Professional Service Industries, Inc. (PSI), an Intertek company, as your consultant for Cottages at Generation Village on Buck Road near Megan Lane in Willard, Missouri. Per your authorization, PSI has completed a geotechnical engineering study for the referenced project.

Should there be questions pertaining to this report, please contact our office at (913) 310-1600. PSI would be pleased to continue providing geotechnical services throughout the implementation of the project, and we look forward to working with you and your organization on this and future projects.

Respectfully submitted,
Professional Service Industries, Inc.

A handwritten signature in blue ink, appearing to read "Darrin Wilson".

Darrin Wilson
Project Manager
Geotechnical Services

A handwritten signature in blue ink, appearing to read "Seth D. Scheilz".

Seth D. Scheilz, PE
Department Manager



**Geotechnical Services Report
Cottages at Generation Village
Buck Road near Megan Lane
Willard, Missouri
PSI Report No. 03382353
April 15, 2022**

Geotechnical Engineering
Services Report

for the
Cottages at Generation Village
Buck Road near Megan Lane
Willard, Missouri

Prepared for

Carlson Consulting Engineers
7068 Ledgestone Commons
Bartlett, Tennessee 38133

Prepared by

Professional Service Industries, Inc.
2828 S. 44th Street
Kansas City, Kansas 66106

April 15, 2022

PSI Project 03382353



A handwritten signature in blue ink.

Darrin Wilson, G.I.T.
Project Geologist
Geotechnical Services

A handwritten signature in blue ink.

John Gordon
Principal Consultant



Reviewed by:
Seth D. Scheilz, P.E.,
Geotechnical Department
Manager
Missouri License #
PE-2020030108
Expires: 12/31/2022

The above Professional Engineering Seal and signature is an electronic reproduction of the original seal and signature. An original hard copy was sent to the client listed on this document. This electronic reproduction shall not be construed as an original or certified document.

TABLE OF CONTENTS

PROJECT INFORMATION	1
Project Authorization.....	1
Project Description	1
Purpose and Scope of Services.....	2
SITE AND SUBSURFACE CONDITIONS	3
Site Location and Description.....	3
Site History (Timeline)	5
Geology.....	6
Exploration Procedures and Subsurface Conditions	6
Subsurface Conditions	6
Water Level Measurements	8
GEOTECHNICAL EVALUATION	8
Geotechnical Discussion	8
Shear Strength and Compressibility of Soil	8
Existing Undocumented Fill	8
High Plasticity Clay.....	10
Shallow Rock.....	11
Moisture Sensitive Soils.....	11
Soil Compaction.....	12
GEOTECHNICAL RECOMMENDATIONS	12
Site Preparation	12
High Plasticity Clay Considerations.....	14
Foundation Recommendations	15
Footing Excavations and Backfilling.....	15
Earthquake and Seismic Design Consideration	16
Floor Slab Recommendations.....	17
Utilities Trenching.....	19
Siltation Control.....	19
Pavement Recommendations	19
Asphalt Pavement.....	20
Portland Cement Concrete Pavement.....	20
Pavement Subgrade Preparation	21
Pavement Drainage & Maintenance	21
Slopes.....	22
CONSTRUCTION CONSIDERATIONS	22



Moisture Sensitive Soils/Weather Related Concerns.....	22
Drainage and Groundwater Considerations.....	22
Excavations	23
GEOTECHNICAL RISK.....	23
REPORT LIMITATIONS	23

LIST OF APPENDICES

- Appendix A - Topographic Map
- Appendix B - Site Vicinity Map
- Appendix C - Boring Location Plan
- Appendix D - Boring Logs
- Appendix E - General Notes/Soil Classification Chart
- Appendix F - Drilled, Field and Lab Testing Procedures



PROJECT INFORMATION

Project Authorization

The following table summarizes, in chronological order, the Project Authorization History for the services performed and represented in this report by Professional Service Industries, Inc. (PSI).

PROJECT TITLE: COTTAGES AT GENERATIONS VILLAGE		
Document and Reference Number	Date	Requested/Provided By
Request for Proposal	2/14/22	Mr. Keith Moore of Carlson Consulting Enigneers
PSI Proposal Number: 0338366233	2/16/22	Darrin Wilson and Mr. Kelly Rotert of PSI
Notice to Proceed	2/17/22	Mr. Nathan Cox of PSI

Project Description

The proposed project consists of the design and construction of a senior housing complex on an approximately 11-acre site. The complex will include four 6-unit 2-bedroom buildings, four 4-unit 2-bedroom buildings, four 4-bedroom single family homes, eight 3-bedroom single family homes, and a community building.

The following table lists the material and information provided for this project:

DESCRIPTION OF MATERIAL	PROVIDER/SOURCE	DATED
Generations - CSP 1 - Site Plan	Carlson Consulting Engineers	4/16/2021

The following table lists the structural loads and site features that are required for or are the design basis for the conclusions of this report:

STRUCTURAL LOAD/PROPERTY	REQUIREMENT/REPORT BASIS	
	BUILDING	R* B*
Maximum Column Loads	40 kips	X
Maximum Wall Loads	2 kips per lineal foot	X
Finish Floor Elevation and Type	Shallow Foundations and Slab on Grade	X
Maximum Floor Loads	150 psf	X
Settlement Tolerances	1 inch total, 3/4 inch Differential	X
	PAVEMENTS	
Pavement 18-kip ESAL (cycle & duration)	Light Duty- 30,000 ESAL Heavy Duty – 60,000 ESAL; with a life expectancy of 20 years	X
	GRADING	
Planned Grade Variations at Site	±10 feet	X

*"R" = Requirement indicates specific design information was supplied.

*"B" = Report Basis indicates specific design information was not supplied; therefore, this report is based on this parameter.



The following image of the site plan was provided to PSI for the preparation of this project:

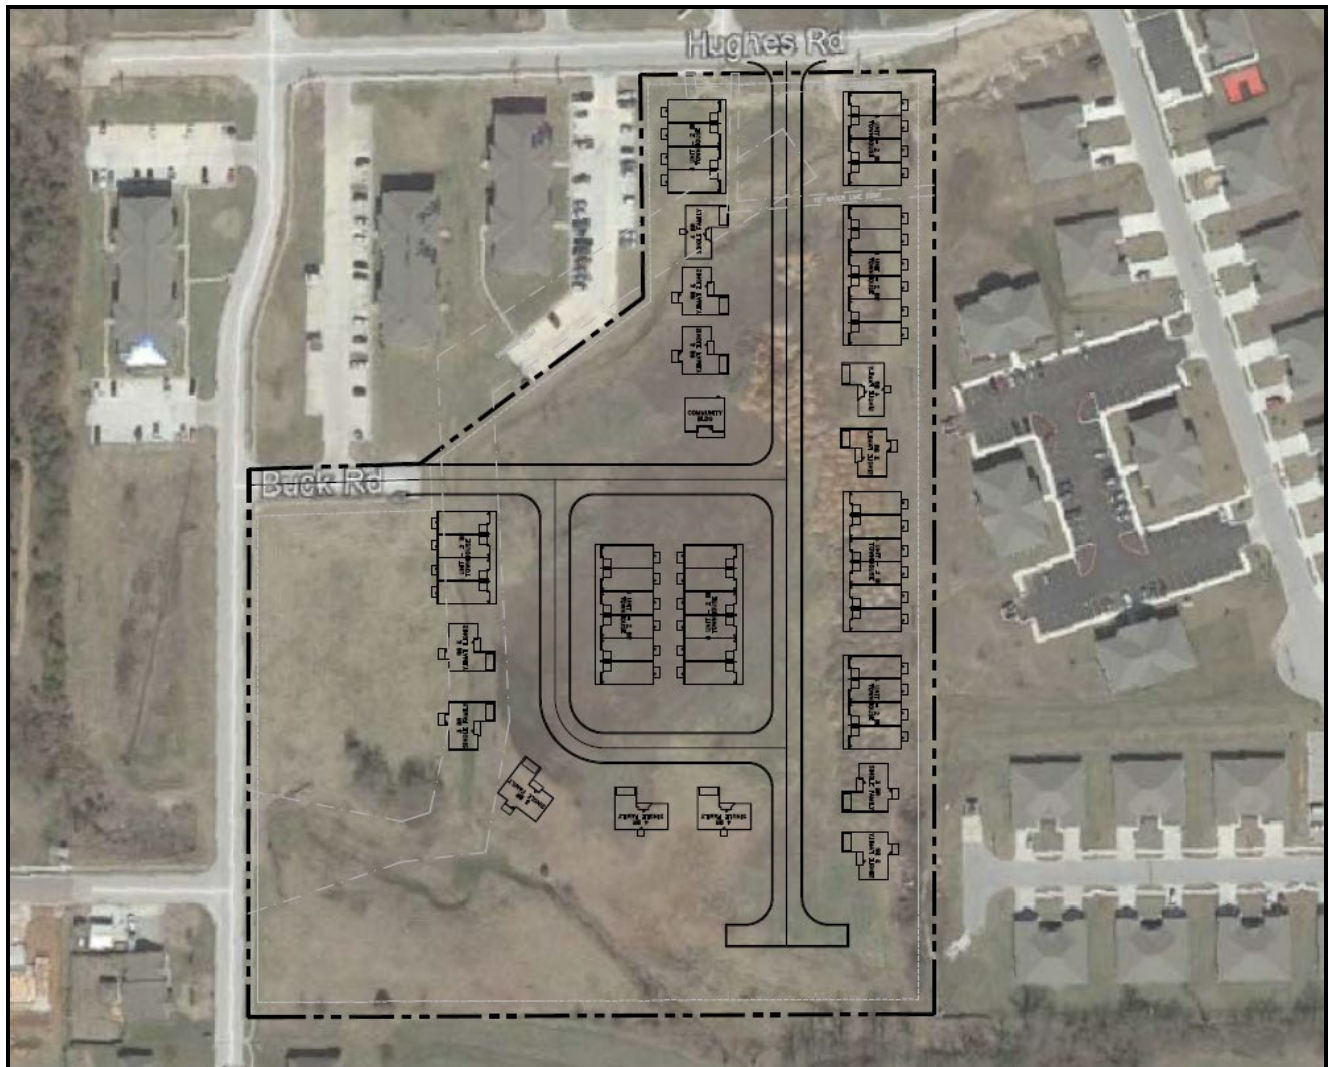


Figure 1. Preliminary Site Plan

The geotechnical recommendations presented in this report are based on the available project information, building locations, and the subsurface materials described in this report. If the noted information is incorrect, please inform PSI in writing so that we may amend the recommendations presented in this report if appropriate and if desired by the client. PSI will not be responsible for the implementation of its recommendations when it is not notified of changes in the project.

Purpose and Scope of Services

The purpose of this study was to explore the subsurface conditions within the site to evaluate and provide recommendations for site preparation and grading and for design of foundation and pavement section systems for the proposed construction. PSI's contracted scope of services included drilling twelve (12) soil test borings at the site, select laboratory testing, and preparation of this geotechnical report. This report briefly outlines the testing procedures, presents available project information, describes the site and subsurface conditions, and presents recommendations regarding the following:



- General site development and subgrade preparation recommendations;
- Estimated potential soil movements associated with shrinking and swelling soils and methods to reduce these movements to acceptable levels;
- Recommendations for site excavation, fill compaction, and the use of on-site and imported fill material under pavements and the structures;
- Recommendations for building pad preparation for ground supported slabs or shallow foundations having a maximum movement potential, due to settlement, of 1-inch;
- Seismic design site classification per the International Building Code (2015);
- Recommendations for the design of flexible asphaltic and rigid concrete pavement systems for the proposed parking and drive areas.

The scope of services did not include an environmental assessment for determining the presence or absence of wetlands, or hazardous or toxic materials in the soil, bedrock, surface water, groundwater, or air on, below, or around this site. Any statements in this report or on the boring logs regarding odors, colors, and unusual or suspicious items or conditions are strictly for informational purposes. PSI's scope also did not provide any service to investigate or detect the presence of moisture, mold or other biological contaminants in or around any structure, or any service that was designed or intended to prevent or lower the risk of the occurrence or the amplification of the same. Client should be aware that mold is ubiquitous to the environment with mold amplification occurring when building materials are impacted by moisture.

SITE AND SUBSURFACE CONDITIONS

Site Location and Description

The approximate 11½-acre site for the proposed Cottages at Generations Village project is located on Buck Road near Megan Lane in Willard, Missouri. The property is bordered by Hughes Road to the north, Becky Street to the south, Fox River Lane to the east, and Megan Lane to the west. At the time of drilling, the site was covered with grass and brush and some piles of construction debris or fill were visible. The site had no visual difference in elevation. The site latitude and longitude are approximately 37.2831° and -93.4038°, respectively. The following is an aerial image from 2019 and generally illustrates the site conditions at the time of drilling:



Figure 2. Aerial Site Photo – March 2019



Site History (Timeline)

Based on historical images obtained from Google Earth™, the site has been general undeveloped or used for agricultural purposes going back to at least March 1997. The site has remained generally unchanged since that time until present day, although the historical images do show piles of fill materials or construction debris stockpiled on the site at different times over the years from the development of adjacent areas.



Figure 3. Historical Aerial Site Photo – March 1997



Geology

According to the Missouri Department of Natural Resources - 1981 Geology of the Willard 7 1/2' quadrangle, map, the bedrock of the subject area belongs to the Burlington-Keokuk Limestone formation, which consists primarily of limestone and chert deposits.

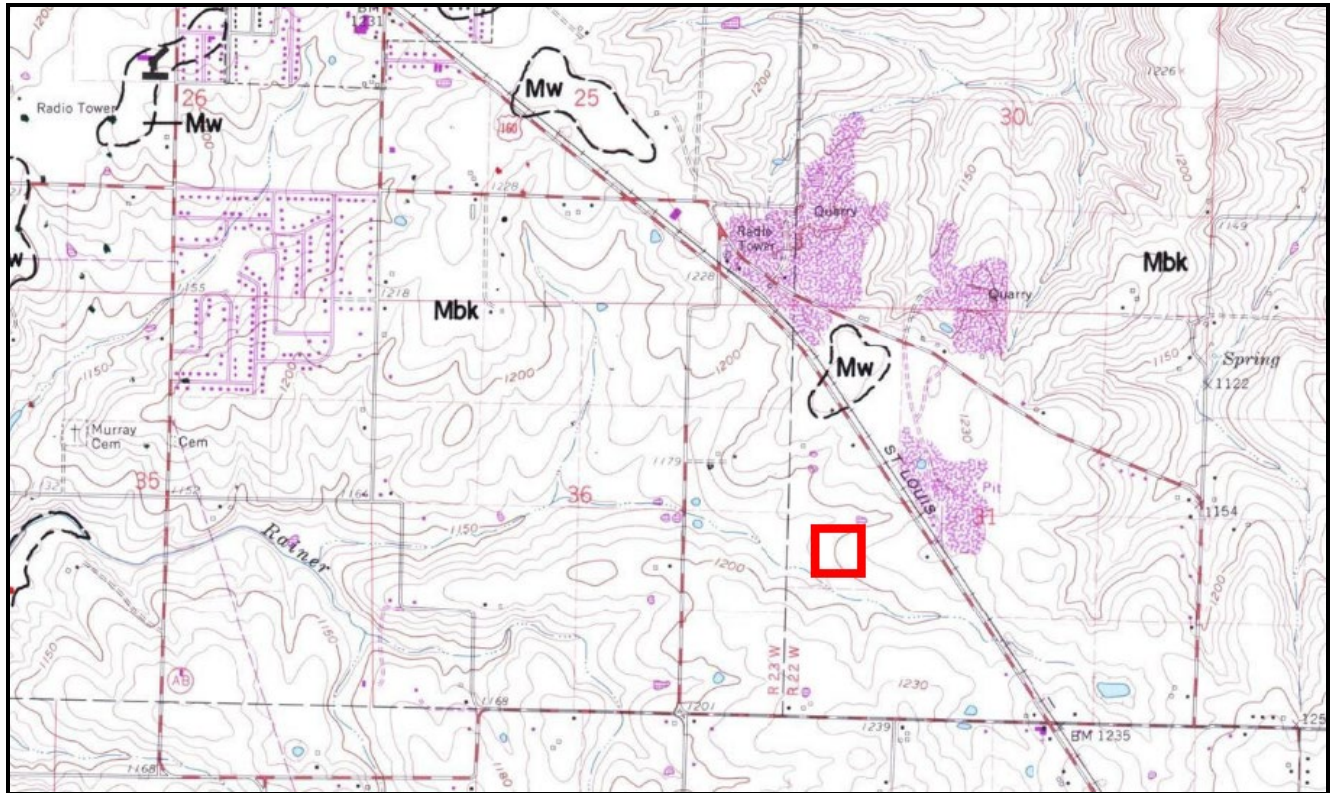


Figure 4. Missouri Department of Natural Resources - 1981 Geology of the Willard 7 1/2' quadrangle

Exploration Procedures and Subsurface Conditions

The soil borings were performed with an ATV-mounted rotary head drill rig and were advanced using 3¼-inch inside diameter hollow-stem augers. Representative samples were obtained employing split-spoon and thin-wall tube sampling procedures in general accordance with ASTM procedures. The laboratory testing program was conducted in general accordance with applicable ASTM specifications. The results of these tests are to be found on the accompanying boring logs located in the Appendix.

Subsurface Conditions

The site subsurface conditions were explored with twelve (12) soil test borings. Nine (9) of these borings were drilled within the proposed building area and three (3) borings were drilled within parking and drive areas. Building boring depths ranged from 3 feet to 23 feet and pavement borings were drilled to depths ranged from 2½ feet to 10 feet.

The boring locations and depths were suggested by PSI and reviewed with the client prior to drilling. PSI personnel staked the borings in the field using a hand-held GPS device.



An organic layer was encountered at the surface of the borings. In general, the thickness of the organic layer ranged from 3 inches to 6 inches. The soils encountered at the twelve (12) borings beneath the organic layer primarily included undocumented fill materials and fine-grained soils overlying weathered rock materials that extended to the terminal depths of the borings. Based on results of Atterberg limits and visual classification, the soils were classified as high plasticity clay (CH) in accordance with the Unified Soil Classification System (USCS). The standard penetration N-values and unconfined compressive strength testing within these fine-grained soils generally indicate consistencies of medium to very hard; however, soils with a soft consistency were encountered at depths of 18½ to 20 feet in Boring B-4. Overall, the moisture contents of the fine-grained soils varied from 4 to 57 percent. The moisture contents of the fine-grained soils in the upper 5 feet ranged from 4 to 48 percent with an average value of 26 percent.

The following table briefly summarizes the range of results from the field and laboratory testing programs. Please refer to the attached boring logs and laboratory data sheets for more specific information:

PROPERTY DESCRIPTION	Approximate Depths Encountered (ft.)	RANGE OF PROPERTY VALUES					
		Standard Penetration, N ₆₀	Moisture Content, %	Dry Unit Weight, pcf	Unconfined Compressive Strength, Qu (tsf)	Liquid Limit, %	Plastic Limit, %
SOIL STRATA TYPE							
Fill – High plasticity clay	0-6	6-31	7-35	-	-	58	24
High plasticity clay	1½-23	3-22	19-57	74-101	0.7-0.8	65-75	24
Cherty high plasticity clay	2-4	21	-	-	-	-	-
Weathered Chert	1½-10	39-SSR	4-52	-	-	-	-

Auger refusal materials were encountered within all of the borings at depths ranging from about 2½ feet at boring B-9 and B-12 to 23 feet at boring B-4. Auger refusal is a designation applied to materials that cannot be further penetrated by the power auger with ordinary effort and is normally indicative of a very hard or very dense material, such as boulders or gravel lenses or the upper surface of bedrock. In addition to the refusal materials, weathered rock layers were encountered above the refusal materials. Rock coring was beyond the scope of this exploration; therefore, the character and continuity of the refusal materials could not be determined.

Split spoon refusal materials were encountered within the borings. Split spoon refusal materials are defined as materials that cannot be penetrated with a standard split spoon using ordinary effort (greater than 50 blows per 6 inches). These materials were encountered in borings B-2, B-7, B-8, B-9, and B-12 at depths ranging from 2 to 9 feet.

The above subsurface description is of a generalized nature to highlight the major subsurface stratification features and material characteristics. The boring logs included in the Appendix should be reviewed for specific information at individual boring locations. These records include soil/rock descriptions, stratifications, penetration resistances, and locations of the samples and laboratory test data. The stratifications shown on the boring logs represent the conditions only at the actual boring locations. Variations may occur and should be expected



between boring locations. The stratifications represent the approximate boundary between subsurface materials and the actual transition may be gradual. Water level information obtained during field operations is also shown on these boring logs. The samples that were not altered by laboratory testing will be retained for sixty (60) days from the date of this report and then will be discarded.

Water Level Measurements

Free groundwater was observed in boring B-4 and was measured between depths of 10 feet and 17 feet. Although free water was not encountered in the other borings at this time, water can be present within the depths explored during other times of the year depending upon climatic and rainfall conditions. Additionally, discontinuous zones of perched water may exist within the overburden materials and/or at the contact with bedrock. The water level measurements presented in this report are the levels that were measured at the time of PSI's field activities.

GEOTECHNICAL EVALUATION

Geotechnical Discussion

There are six (6) primary geotechnical characteristics at this site, which will affect the selection and performance of the foundations for this structure and the development of the site. The following summarizes those concerns:

1. The shear strength and compressibility of the upper soils will control the behavior of the proposed structure.
2. Existing undocumented fill materials of variable consistency were encountered within the project area.
3. High plasticity "fat" clays were encountered in the exploration that could require remediation.
4. Shallow rock was encountered in the building area that could be difficult to excavate for general grading, footings and utility trenches.
5. Dissimilar bearing materials will likely be encountered at the footing subgrade elevations.
6. Relatively wet and moisture sensitive soils were encountered in the upper parts of the borings and equipment mobility difficulty may be anticipated.

Shear Strength and Compressibility of Soil

The primary geotechnical property controlling the bearing capacity and compressibility of the soils bearing the applied loads is the shear strength of the clay soil. Based on 2 feet of cut or fill and a shallow foundation bearing at a depth of 3 feet below exterior or adjacent grades, the applied foundation load on a shallow foundation up to 4 feet wide will be distributed through the 8 to 12 feet of soil generally beneath the footing. PSI believes the shear strength of the soils in this zone ranges from 700 psf to 3,000 psf. PSI anticipates that an engineered fill placed as recommend in this report would have a minimum shear strength of 1,800 psf. This shear strength is considered "undrained" or a "total stress" parameter and will be used in conjunction with other physical and geometric parameters to calculate an allowable bearing capacity.

The soil in the influence area of the floor slab and footings is relatively compressible. This soil will control the allowable bearing pressure settlement, and earthquake site class of the proposed structure. The recommended bearing pressures presented in this report are based on the settlement tolerances provided.

Existing Undocumented Fill

The presence of undocumented fill across the site introduces a construction risk due to the potential for excessive and/or non-uniform settlement. Fill is defined as follows:



Fill; Man placed soil is called fill, and the process of placing it is termed filling. One of the most common problems of earth construction is the wide variability of the source soil, termed borrow. An essential part of the geotechnical engineering report is to provide guidance for the placement of fill from a borrow source in a manner that achieves the design parameters for the project being constructed. Fill is further classified by the placement process. The following lists various terms applied to fill placement practices:

- a. **Uncontrolled Fill;** fill material that consists of soil and/or non-soil materials that has been placed in a manner that does not produce consistent density, uniform moisture content at time of placement, and in general materials of durable physical characteristics is termed an uncontrolled fill.
- b. **Undocumented Fill;** fill material composed of soil that has **not** been observed by a geotechnical engineer or qualified technician under the direction of a geotechnical engineer during the actual fill placement process with physical measurements of lift thickness, dry density, moisture content at time of placement, location of tests and fill soils placed, and the methodology of placement with types of placement equipment is termed undocumented fill.
- c. **Engineered Fill;** fill material that is placed to have specific shear strength, permeability, consolidation, or other physical parameter(s) specific to the end use of the man placed soil material. Applications include, but are not limited to, retaining wall backfill, pond and landfill liners, embankments, dams, and bridge abutments.

Since the proposed structures are lightly loaded, the owner may elect to accomplish select site improvement and accept this risk in exchange for the potential cost savings of not removing the fill. If the risk is acceptable, it should be possible to use shallow footing foundations for support of the proposed structural loads.

To reduce the settlement risk, PSI recommends that the foundations extend through the fill to natural material. Alternatively, the foundation excavations can be made to natural soil and structural fill be placed to footing grade.

The site is underlain by up to six (6) feet of undocumented fill which introduces a construction risk and precludes typical site development and construction. Although it may be possible to utilize conventional spread footing foundations after completing the recommended grading and foundation preparation, the owner must accept a risk that excessive and/or non-uniform settlement may occur.

Risk of undocumented fill settlement can be reduced if the existing undocumented fill is substantially removed and replaced with a controlled compacted low plasticity fill. However, an excavation to remove the existing undocumented fill will increase construction costs.

In order to reduce the potential of larger than normal settlement of floor slabs and to provide uniform support for slabs-on-grade, PSI recommends that, at a minimum, the upper two (2) feet of fill be removed, conditioned, and recompacted or replaced with properly placed and compacted low plasticity structural fill within the proposed building or structural footprint limits.

Although soft undocumented fill soils were not encountered in the upper 10 feet of the soil profile at the boring locations, this does not eliminate the possibility that soft or loose pockets or layers are present between and/or beyond the borings.



If the owner is willing to accept the risk by utilizing the undocumented fill, the new construction can be supported on shallow foundations and the site can be prepared as described herein. PSI can provide recommendations for an extensive excavation if requested. However, evaluation for a deep foundation could only be provided if deeper borings are authorized to allow proper evaluation.

PSI has presented these recommendations with the understanding that the owner is willing to accept an elevated risk of building settlement and utilize the existing undocumented fill by supporting the structure on a shallow spread footing foundation. PSI recommends a typical approach to site development and construction and provides a minimum level of fill mitigation. This includes typical observations of the excavated foundation areas and reworking of shallow, visually unsuitable fill soil.

The presence of undocumented fill introduces a construction risk due to the potential for excessive and/or non-uniform settlement. To reduce the settlement risk, PSI recommends that the foundations extend through the fill to natural material or bear on new compacted and documented structural fill soils bearing on native soils.

High Plasticity Clay

High plasticity "fat" clays are present in the project area that may expand and shrink thereby impacting the proposed construction. Where these soils are within about two feet of lightly loaded structural features or slabs and 1 foot of pavements, remediation or class "C" fly ash, portland cement or lime-treatment of the high plastic clays can be performed. Class "C" fly ash, portland cement or lime-treatment of the high plastic clay would reduce the plasticity index, improve workability, promote drying, and reduce shrink/swell potential. Lightly loaded structures are defined as having normal operating loads of less than 2 kips per linear foot for walls and 50 kips for columns. Fat clays have the potential for volume change with changes in the soil moisture content. In severe cases, movement and distress to footings and foundation walls can occur, although a severe case is not obviously apparent at this site. Remedial measures are recommended in select areas of the site to reduce the shrink/swell potential. Grading the subgrade to drain and not trap water below the slabs and pavements is recommended to further reduce the potential of distress from these soils.

Shallow rock is also expected to be encountered (within 3 feet of the possible finish floor elevation). In this scenario, trapped water or possibly even flowing water could be present between the rock surface and clay interface and could cause significant changes in the moisture content depending climate/seasonal changes. This would increase the risk for potential shrink and swell to occur. In areas where bedrock is within 5 feet of finish floor, PSI recommends the lower 8 inches of the recommended 24 inches of remediation be completed by treating the on-site fat clay soils with class "C" flyash and then following with the placement of 16 inches of well-graded stone with fines, similar to MODOT type 5 on top of the treated soils. Class "C" flyash or lime-treatment of the high plastic clay would reduce the plasticity index, improve workability, promote drying, and reduce shrink/swell potential. A second option would be to place 24 inches of granular materials below the floor slab and forgo the treatment process. The increased stone layer will further reduce the shrink/swell potential by providing increased drainage beneath the floor slab, which should reduce the potential for rapid moisture content changes from occurring to the subgrade soils beneath the building.

In either case PSI recommends that the drainage layer including a French drain system that is connected to the perimeter footings drains and connected to the planned storm drainage system. This will prevent water from pooling beneath the building and allow drainage to occur more quickly.



Shallow Rock

Weathered rock consisting of chert was encountered within the upper 5 feet in borings B-1, B-7, B-8, B-9 and B-12. Auger refusal was encountered at approximately 2½ to 3 feet in depth in borings B-1, B-7, B-8, B-9 and B-12. Some of the weathered chert may be difficult to excavate, especially in footing and utility trenches. Excavation machinery equipped with rock chippers may be required in some locations. In addition, intact ledges or boulders of sound and hard rock may be encountered within the weathered chert layers that could increase the excavation difficulty.

Moisture Sensitive Soils

The presence of potentially moisture sensitive shallow soils will increase the difficulty of site grading. PSI has been involved with projects in this region where these soils can undergo a loss of stability during wetter portions of the year. PSI anticipates that the soils at their current moisture levels will become easily disturbed if subjected to conventional rubber tire or narrow track-type equipment resulting in a loss of strength and characteristic "pumping". Soils that become disturbed would need to be excavated and replaced; however, this remedial excavation may expose progressively wetter soils with depth, thus compounding the condition. Thus, a normal approach to subgrade preparation may not be possible. In the event these conditions are observed, PSI recommends that the following remediation procedures be considered to further stabilize wet/soft areas if typical surface moisture conditioning/disking/recompacting methods are not effective.

1. Track in 3 to 5-inch minus well-graded crushed limestone or similar material into the failing areas to attempt to bridge the soft zones. These materials should be placed in loose lifts of no more than 10 inches and tracked in with a loaded rubber tire truck or beat in with a backhoe bucket. Once the areas are stabilized onsite soils then be placed to the recommended low volume change material subgrade elevation for pavements. If for some reason areas do not stabilize with 1 to 2 lifts of stone, a layer of grid or fabric may need to be incorporated into those areas at that time, followed by additional lifts of stone consisting of ¾ inch minus materials (MoDot Type 5).
2. A second option would be to place geo grid similar to Tensar BX1100 and then place new granular fill similar to ¾-inch minus material in compacted lifts. The grid should extend at least 10 feet past the perimeter of the failing areas and should be overlapped according to the manufacturer's requirements. If the area does not stabilize by the second lift of ¾ inch minus material an additional layer of grid should then be placed and the process should be repeated until it is stabilized.

PSI recommends a test section be performed to verify the selected remediation method.

Dissimilar Bearing Materials

Footings for the building should bear on similar materials. PSI anticipates both high plasticity clay and weathered chert at the finished floor elevation and footing depth. However, the high plasticity clay bearing material may be relatively wet and weak in comparison to the weathered chert. PSI recommends that footing excavations that encounter relatively hard rock or soft soils be over-excavated and backfilled with a low plasticity fill material to a depth of approximately one (1) foot. The footings will then bear on similar material, which reduces the potential of relative differential settlement.



Soil Compaction

Since the surface soils at the site predominantly consist of high moisture content clay soils and high plasticity clays, it may become difficult to achieve the desired compaction of the soils due to high current moisture contents. After stripping activities the surface soils may also not pass a proof roll in their high moisture content state. The soils may need to be scarified and dried to a moisture content that will facilitate compaction in accordance with the structural fill requirements of this report. If scarifying, drying and recompacting of the soils does not stabilize the soils, removing and replacement with new structural fill or treating the soils with class "C" fly ash, portland cement or lime-treatment of the clay soils may need to be performed.

GEOTECHNICAL RECOMMENDATIONS

The following geotechnical related recommendations have been developed on the basis of the subsurface conditions encountered and PSI's understanding of the proposed development. Should changes in the project criteria occur, a review must be made by PSI to determine if modifications to our recommendations will be required.

Site Preparation

PSI recommends that topsoil, vegetation, roots, soft, organic, frozen, or unsuitable soils in the construction areas be stripped from the site and either wasted or stockpiled for later use in non-structural areas. In the event that roots/rootlets are observed within the existing soils, it would be acceptable for the soils to consist of 5 percent by volume of root/rootlets to be left in place of roots that are ¼ inch or less in diameter. Larger roots or tree root bulbs should be removed and replaced with new structural fill as recommended below. Depth of the organic layer in our borings ranged from approximately 3 to 6 inches. It is typical for the organic layer thickness to vary from these values. A representative of the geotechnical engineer should evaluate and document the required depth of removal at the time of construction.

After stripping to the proposed subgrade level, as required, the building and parking/drive areas should be proof-rolled with a loaded tandem axle dump truck or similar heavy rubber tired vehicle (typically with an axle load greater than nine (9) tons). Soils that are observed to rut or deflect excessively (typically greater than one (1) inch) under the moving load should be undercut and replaced with properly compacted low plasticity fill material. The proof-rolling and undercutting activities should be witnessed by a representative of the geotechnical engineer and should be performed during a period of dry weather. Care should be taken during construction activities not to allow excessive drying or wetting of exposed soils. The subgrade soils should be scarified and compacted to at least 95% of the materials' standard Proctor maximum dry density, in general accordance with ASTM procedures, to a depth of at least twelve (12) inches below the surface. New fill for building structures, asphalt, and concrete should not be placed on frozen ground.

High plasticity fat clays should be removed where they are present within a depth of two (2) feet beneath proposed slabs or lightly loaded structural features. This material should be replaced with a low plasticity compacted soil, a dense positively-drained graded crushed stone or class "C" fly ash, portland cement or lime-treatment of the high plastic clays can be performed. Class "C" flyash or lime-treatment of the high plastic clay would reduce the plasticity index, improve workability, promote drying, and reduce shrink/swell potential. A representative of PSI's geotechnical engineer should observe the subgrade soils, perform plasticity index tests, and estimate the approximate extent of the exposed fat clays. If it is desirable to modify the fat clays with a commercially available class "C" fly ash, portland cement or lime product, PSI recommends that actual application amounts be set by conducting a laboratory class "C" fly ash, portland cement or lime series test. However, for



preliminary purposes, the amount of class “C” fly ash will likely range from 10 to 15 percent by weight. There are many variables including water and soils chemistry and the variable nature of class “C” fly ash. Therefore, a laboratory test is recommended. The geotechnical engineer’s representative should observe the remediation procedures for compliance with the project plans and specifications.

Moisture content changes, typically either higher than 3% above the plastic limit or lower than the plastic limit, in the highly plastic soils should not be permitted during or after construction. Increases in moisture content can cause swelling of the high plasticity soils during construction and increase shrinkage potentials due to drying after construction. If the exposed fat clays become inundated or desiccated, PSI recommends they be removed prior to new fill placement. Ideally, excavation should be performed during a period of dry weather.

After subgrade preparation and observation have been completed, fill placement required to establish grade may begin. Low-plasticity structural fill materials placed beneath the lightly loaded structural features or slabs should be free of organic or other deleterious materials and have a maximum particle size of less than three (3) inches. Low-plasticity soils are defined as having a liquid limit less than forty-five (45) and plasticity index less than twenty-five (25). The on-site high plasticity fat clay soils may be utilized as fill material to within two (2) feet below the final subgrade for lightly loaded structures and building slabs. If high plasticity fat clays are utilized as fill, they should have a liquid limit no greater than seventy-five (75) and a plasticity index no greater than forty-five (45). A representative of PSI should be on-site to observe, test, and document the placement of the fill. If the fill is too dry, water should be uniformly applied and thoroughly mixed into the soil by disking or scarifying. Close moisture content control will be required to achieve the recommended degree of compaction. It should be noted that high plasticity clays are typically more difficult to compact and achieve the optimum moisture content during the placement of fill.

Fill should be placed in maximum loose lifts of eight (8) inches and compacted to at least 95% of the materials’ standard Proctor maximum dry density, and within a range of the optimum moisture content as designated in the table below, as determined in general accordance with ASTM procedures. Each lift of compacted-engineered fill should be tested and documented by a representative of the geotechnical engineer prior to placement of subsequent lifts. The edges of compacted fill should extend a minimum of five (5) feet beyond the building footprint, or a distance equal to the depth of fill beneath the footings, whichever is greater. The measurement should be taken from the outside edge of the footing to the toe of the excavation prior to sloping.

The fill placed should be tested and documented by a geotechnical technician and directed by a geotechnical engineer to evaluate the placement of fill material. It should be noted that the geotechnical engineer of record can only certify the testing that is performed and the work observed by that engineer or staff in direct report to that engineer. The fill should be evaluated in accordance with the following table:

MATERIAL TESTED	PROCTOR TYPE	MIN % DRY DENSITY	PLACEMENT MOISTURE CONTENT RANGE	FREQUENCY OF TESTING * ¹
Structural Lean Clay Fill* (Cohesive)	Standard	95%	-1 to +3 %	1 per 2,500 ft ² of fill placed / lift
Structural Fat Clay Fill* (Cohesive)	Standard	95%	0 to +3%	1 per 2,500 ft ² of fill placed / lift
Structural Fill (Granular)*	Standard	95%	-2 to +2 %	1 per 2,500 ft ² of fill placed / lift
Random Fill (non-load bearing)	Standard	90%	-3 to +3 %	1 per 6,000 ft ² of



				fill placed / lift
Utility Trench Backfill	Standard	95%	-1 to +2 %	1 per 150 lineal foot / lift

*Structural Fill is defined as fill beneath or supporting any improvements on site such as foundation, slabs, pavements, etc.

*¹ Minimum 3 per lift.

The test frequency for the laboratory reference should be one laboratory Proctor or Relative Density test for each material used on the site. If the borrow or source of fill material changes, a new reference moisture/density test should be performed.

Tested fill materials that do not achieve either the required dry density or moisture content range shall be recorded, the location noted, and reported to the Contractor and Owner. A re-test of that area should be performed after the Contractor performs remedial measures.

High Plasticity Clay Considerations

Due to the presence of high plasticity clays, consideration should be given to measures that can reduce the long term shrink/swell potential of the clay soils. High plasticity clays expand or shrink by absorbing or losing moisture; therefore, reducing the moisture content variation of a soil will reduce its volume change. Although it is not possible to prevent soil moisture changes, a number of steps may be taken to aid in the reduction of subsoil moisture content variations. These steps are intended to help reduce the shrink/swell potential, not eliminate it. Some of these measures are:

1. During construction, a positive drainage scheme should be implemented and maintained to prevent ponding of water on subgrades.
2. The building subgrade should not be allowed to dry out; backfill should proceed as soon as possible to minimize changes in the natural moisture regime.
3. Permanent positive drainage should be maintained around the building through a roof/gutter system connected to drainage piping or discharging upon paved surfaces, thereby transmitting water away from the foundation perimeter. In addition, site grading should provide rapid drainage of surface water away from foundation areas.
4. Utility trenches should be backfilled with low plasticity clays or lean concrete to reduce the potential of the trenches to act as aqueducts transmitting water beneath the structures due to excess surface water infiltration.
5. Shrubbery, flower beds and sprinkler systems surrounding the structures should be eliminated or at least limited, and should be designed so that the bedding soils drain away from the building areas. The planters should have impermeable bases with weep holes discharging into drainage pipes or onto paved surfaces.
6. Trees and/or large bushes should not be planted adjacent to the structures.
7. Since plumbing and other water leaks can cause excessive heaving of high plasticity soils, every effort should be made to maintain the plumbing in good working order and prevent or minimize water leaks and discharges. It is recommended that all water supply lines and waste water lines be tested for leaks prior to backfilling the utility trenches.



Foundation Recommendations

The planned construction can be supported on conventional spread-type footing foundations bearing on either competent naturally deposited soils, compacted-engineered fill or the existing fill (providing the owner is willing to accept the risk). PSI recommends a minimum dimension of 24 inches for square footings and 18 inches for continuous footings to reduce the possibility of a local bearing capacity failure.

Footings for the structure should bear on similar materials. PSI anticipates both clay and chert/limestone will be encountered depending on final design elevations. However, the clay bearing material will be relatively wet and weak in comparison to the chert/limestone. PSI recommends that footing excavations be extended to where all foundations are supported on one type of bearing material. If the final design elevations do not allow for this option and footings are to bear on a combination of chert/limestone and clay then the relatively hard rock should be over-excavated and backfilled with a low plasticity material to a depth of approximately one (1) foot. The footings will then bear on similar material, which reduces the potential of relative differential settlement. Spread footings for columns and continuous footings for bearing walls can be designed for the following allowable soil bearing pressures:

Allowable bearing Pressure (psf)		
Bearing Surface	Column Footings	Continuous Footings
Lean and Fat Clay	2,200	1,900
Chert/Limestone	10,000	10,000
Engineered Fill	3,000	2,500

If undocumented fill soils are encountered and elected to be left in place after stripping and excavating to the proposed subgrade level, the foundation bearing surface should be proof compacted with a hydraulic vibratory compactor plate that exerts at least 16,000 pounds of impulse force at 2,100 cycles per minute on a plate no larger than 29 inches by 32 inches. If the ground becomes unstable or compresses more than 1 inch, the foundation soils shall be over excavated and replaced until either the subgrade passes the proof compaction or a thickness of 2 times the minimum base width of the foundation below the foundation is replaced with documented structural fill. It should be noted that there will be some elevated potential for higher settlements with this approach oppose to traditional proof-rolling methods. Proof compaction should be observed and documented by the engineer of record or their direct representative during the foundation preparation work.

If documentation can not be provided for the fill soils that will be required to re-establish grades during the demolition efforts of the existing structure, that fill will be required to be removed and replaced with documented structural fill within the building area and up to five feet outside the building perimeter. PSI strongly recommends that a representative of the geotechnical firm be onsite during the placement of fill soil during demolition.

Footing Excavations and Backfilling

It is recommended that PSI personnel evaluate the soils conditions at and below footing grade at the time the excavations are performed. If unsuitable materials (such as, soft to medium stiff cohesive soils, loose granular soils that cannot be densified, or debris/organic laden fill materials) are encountered below the design bottom of footing elevation, the footing excavations should be extended deeper to reach adequate bearing



soils or an overexcavation and backfill procedure could be performed with lean clay, lean concrete or compacted granular fill to the design bearing elevation. If lean concrete (minimum $f'_c = 1500$ psi) is used, the excavation should be widened at least 6 inches from all edges of the design footing width. For the overexcavation and either lean clay or granular backfill options, we recommend the excavation extend laterally at least 8 inches beyond all edges of the footing for each 12 inches of additional excavation required below foundation design elevation. The overexcavation should then be backfilled up to design elevation. Common practice in the area is to use coarse crushed stone backfill placed in lifts of 9 inches or less in loose thickness and compacted to a degree that sufficient interlocking of the aggregate has occurred. A capping layer (minimum 6 inches thick) consisting of well-graded granular material is recommended to fill voids in the surface of the coarse stone and provide a level surface for concrete placement. The capping materials should be compacted to at least 95 percent of the material's maximum dry density per ASTM D698.

Exterior footings and footings in unheated areas should be located at a depth of thirty-six (36) inches or deeper below the final exterior grade to provide adequate frost protection. If the building is to be constructed during the winter months or if footings will likely be subjected to freezing temperatures after foundation construction, then the footings should be protected from freezing. PSI recommends that interior footings be a minimum depth of eighteen (18) inches below the finished floor elevation. Footings bearing on competent rock can be located at nominal depths compatible with architectural and structural considerations.

The foundation excavations should be observed and documented by a representative of PSI prior to steel or concrete placement to assess that the foundation materials are consistent with the materials discussed in this report, and therefore are capable of supporting the design loads. Soft or loose soil zones encountered at the bottom of the footing excavations should be removed to the level of competent naturally deposited soils or properly compacted structural fill as directed by the geotechnical engineer. Cavities formed as a result of excavation of soft or loose soil zones should be backfilled with lean concrete or dense graded compacted crushed stone.

After opening, footing excavations should be observed and concrete placed as quickly as possible to avoid exposure of the footing bottoms to wetting and drying. Surface run-off water should be drained away from the excavations and not be allowed to pond. If possible, the foundation concrete should be placed during the same day the excavation is made. If it is required that footing excavations be left open for more than one day, they should be protected to reduce evaporation or entry of moisture.

Settlement estimates are difficult to determine when fill of an unknown origin and composition are left in place. There is the possibility that soft and/or compressible soil zones may exist which can cause excessive total and/or differential settlement. The recommendations presented in this report were prepared to balance excessive cost associated with removal of the existing fill with reasonable associated risk. This risk can only be eliminated through complete fill removal and replacement with a properly compacted structural fill.

Be advised that as a part of the foundation selection process, there is a cost/benefit evaluation. Although PSI is recommending a specific foundation type, we have not accomplished the cost/benefit evaluation.

Earthquake and Seismic Design Consideration

The 2015 International Building Code (IBC) requires that a site class be determined for the calculation of earthquake design forces in structures. The site class designation is a function of soil type (i.e., depth of soil and strata types). Based on PSI's borings and experience in this area, Site Class "C" is recommended. The USGS-NEHRP probabilistic ground motion values interpolated between the nearest four grid points from latitude 37.2829° and longitude -93.4040° are as follows:



Period (Seconds)	2% Probability of Event in 50 Years (%g)	Site Coefficients	Max. Spectral Acceleration Parameters	Design Spectral Acceleration Parameters	
0.2 (S_s)	0.183	$F_a = 1.2$	$S_{ms} = 0.219$	$S_{Ds} = 0.146$	$T_0 = 0.155$
1.0 (S_1)	0.100	$F_v = 1.7$	$S_{m1} = 0.170$	$S_{D1} = 0.113$	$T_s = 0.774$
$S_{ms} = F_a S_s$ $S_{m1} = F_v S_1$					
$S_{Ds} = \frac{2}{3} * S_{ms}$ $S_{D1} = \frac{2}{3} * S_{m1}$					
$T_0 = 0.2 * S_{D1} / S_{Ds}$ $T_s = S_{D1} / S_{Ds}$					

The Site Coefficients, F_a and F_v were interpolated for IBC 2015 Tables 1613.3.3(1) and 1613.3.3(2) as a function of the site classifications and the mapped spectral response acceleration at the short (S_s) and 1-second (S_1) periods.

Based on the Spectral Acceleration values for this site, structures with a Risk Category of I, II, and III (Table 1604.5) could be designed as a Seismic Design Category B as defined in Tables 1613.3.5(1) and 1613.3.5(2). Structures with a Risk Category IV could be designed as a Seismic Design Category C. The Risk Category is based on the nature of the occupancy of the structure and is typically determined by the design team (Architect/Structural Engineer) or building official. The determination of the Risk Category is beyond PSI's scope of service.

According to IBC 2015, Section 1803.5.11 requires that sites with a Seismic Design Categories C through F be evaluated for slope instabilities, liquefaction, surface rupture due to faulting or lateral spreading and estimates on the differential settlement. A detailed study of these effects was beyond PSI's scope of services. However, the following table presents a qualitative assessment of these issues considering the site class, the subsurface soil properties, the groundwater elevation, and probabilistic ground motions:

HAZARD	RELATIVE RISK	COMMENTS
Slope Stability	Low	The site is relatively flat and does not/will not incorporate significant cut or fill slopes
Liquefaction	Low	The soil within the upper 23 feet of the subsurface profile is a relatively dense and/or cohesive soil
Settlements	Low	Based on the cohesive nature of the soils, the excess pore pressures generated by a seismic event should not induce a significant settlement
Surface Rupture	Low	The site is not underlain by a mapped Holocene-aged fault

Floor Slab Recommendations

The floor slab can be grade supported on a minimum of twenty-four (24) inches of properly compacted low plasticity structural fill. Alternatively, class "C" fly ash, portland cement or lime-treatment of the high plastic clay can be accomplished to reduce the plasticity index, improve workability, promote drying, and reduce shrink/swell potential. Proof-rolling, as discussed earlier in this report, should be accomplished to identify soft or unstable soils that should be removed from the floor slab area prior to fill placement and/or floor slab construction. These soils should be replaced with properly compacted structural fill as described earlier in this report. Fat clays and undocumented fill materials below floor slabs should be remediated, as discussed earlier. In rock cut areas, the floor slab should be underlain by one foot of compacted fill.



PSI recommends that a minimum four (4) inch thick free-draining granular mat be placed beneath the floor slab to enhance drainage. This 4-inch mat can be included in the 24 inches of remediation recommended in the areas of undocumented fill and fat clay. The soil surface shall be graded to drain away from the building without low spots that can trap water prior to placing the granular drainage layer. Polyethylene sheeting should be placed to act as a vapor retarder where the floor will be in contact with moisture sensitive equipment or products such as tile, wood, carpet, etc., as directed by the design professional. The decision to locate the vapor retarder in direct contact with the slab or beneath the layer of granular fill should be made by the design professional after considering the moisture sensitivity of subsequent floor finishes, anticipated project conditions, and the potential effects of slab curling and cracking. The floor slabs should have an adequate number of joints to reduce cracking resulting from differential movement and shrinkage.

For subgrade prepared as recommended and properly compacted fill, a modulus of subgrade reaction, k value, of 140 pounds per square inch/inch may be used in the grade slab design based on correlation to values typically resulting from a 1 ft. x 1 ft. plate load test. However, depending on how the slab load is applied, the value will have to be geometrically modified. Where slab loading is distributed over more than a 1 foot by 1 foot area, the value k should be adjusted for larger areas using the following expression for cohesive and cohesionless soil:

$$\text{Modulus of Subgrade Reaction, } k_s = \left(\frac{k}{B} \right) \text{ for cohesive soil and}$$
$$k_s = k \left(\frac{B+1}{2B} \right)^2 \text{ for cohesionless soil}$$

Where: k_s = coefficient of vertical subgrade reaction for loaded area,
 k = coefficient of vertical subgrade reaction for 1 square foot area, and
 B = effective width of area loaded, in feet

The precautions listed below should be followed for construction of slab-on-grade pads. These details will not reduce the amount of movement, but are intended to reduce potential damage should some settlement of the supporting subgrade take place. Some increase in moisture content is inevitable as a result of development and associated landscaping. However, extreme moisture content increases can be largely controlled by proper and responsible site drainage, building maintenance and irrigation practices.

- Cracking of slab-on-grade concrete is normal and should be expected. Cracking can occur not only as a result of heaving or compression of the supporting soil and/or bedrock material, but also as a result of concrete curing stresses. The occurrence of concrete shrinkage crack, and problems associated with concrete curing may be reduced and/or controlled by limiting the slump of the concrete, proper concrete placement, finishing, and curing, and by the placement of crack control joints at frequent intervals, particularly where re-entrant slab corners occur. The American Concrete Institute (ACI) recommends a maximum panel size (in feet) equal to approximately three times the thickness of the slab (in inches) in both directions. For example, joints are recommended at a maximum spacing of twelve (12) feet based on having a four-inch slab. PSI also recommends that the slab be independent of the foundation walls. Using fiber reinforcement in the concrete can also control shrinkage cracking.
- Areas supporting slabs should be properly moisture conditioned and compacted. Backfill in all interior and exterior water and sewer line trenches should be carefully compacted to reduce the shear stress in the concrete extending over these areas.

Exterior slabs should be isolated from the building. These slabs should be reinforced to function as independent units. Movement of these slabs should not be transmitted to the building foundation or superstructure.



Utilities Trenching

Excavation for utility trenches shall be performed in accordance with OSHA regulations as stated in 29 CFR Part 1926. It should be noted that utility trench excavations have the potential to degrade the properties of the adjacent fill materials. Utility trench walls that are allowed to move laterally can lead to reduced bearing capacity and increased settlement of adjacent structural elements and overlying slabs.

Backfill for utility trenches is as important as the original subgrade preparation or structural fill placed to support either a foundation or slab. Therefore, it is imperative that the backfill for utility trenches be placed to meet the project specifications for the structural fill of this project. PSI recommends that flowable fill or lean mix concrete be utilized for utility trench backfill. If on-site soils are placed as trench backfill, the backfill for the utility trenches should be placed in four (4) to six (6) inch loose lifts and compacted to a minimum of 95% of the maximum dry density achieved by the standard Proctor test. The backfill soil should be moisture conditioned to be within 2% of the optimum moisture content as determined by the standard Proctor test. Up to four (4) inches of bedding material placed directly under the pipes or conduits placed in the utility trench can be compacted to the 90% compaction criteria with respect to the standard Proctor. Compaction testing should be performed for every 200 cubic yards of backfill place or each lift within 200 linear feet of trench, which ever is less. Backfill of utility trenches should not be performed with water standing in the trench. If granular material is used for the backfill of the utility trench, the granular material should have a gradation that will filter protect the backfill material from the adjacent soils. If this gradation is not available, a geosynthetic non-woven filter fabric should be used to reduce the potential for the migration of fines into the backfill material. Granular backfill material shall be compacted to meet the above compaction criteria. The clean granular backfill material should be compacted to achieve a relative density greater than 75% or as specified by the geotechnical engineer for the specific material used.

Siltation Control

The soils at the site are generally fine-grained in nature and are susceptible to erosion. Appropriate erosion control measures such as proper site contouring during general grading and siltation fences should be used during construction so that eroded materials remain onsite. Depending on the length of time the subgrade is exposed and the amount of siltation which occurs, it may be necessary to periodically remove materials collected by the silt fences.

Pavement Recommendations

PSI's scope of services did not include extensive sampling and CBR testing of existing subgrade or potential sources of imported fill for the specific purpose of detailed pavement analysis. Instead, this report is based on pavement-related design parameters that are considered to be typical for the area soils types.

Pavement sections can be grade supported on a minimum of twelve (12) inches of properly compacted low plasticity structural fill. Class "C" fly ash, portland cement or lime-treatment of the on-site high plastic clays can also be performed. The crushed stone base can be included in the 12 inches of remediation recommended in the areas of undocumented fill and fat clay. Proof-rolling, as discussed earlier in this report, should be accomplished to identify soft or unstable soils that should be removed from the pavement area prior to fill placement and/or pavement construction. These soils should be replaced with properly compacted structural fill as described earlier in this report.



Pavement sections were evaluated using Pavement Assessment Software (PAS), which is based on the 1993 AASHTO Design equations, a reliability of 80%, an annual growth rate of 2%, and a 20 year equivalent 18-kip single axle load (ESAL) of 30,000 for light duty pavements and 60,000 for heavy duty pavements. Flexible Pavements were evaluated based on an initial serviceability of 4.2 and a terminal service of 2.0. Rigid Pavements were evaluated based on an initial serviceability of 4.5, a terminal service of 2.0, an unreinforced concrete mix with a 28-day modulus of rupture of 650 pounds per square inch (psi) (approximately 4,000 psi compressive strength), are to be edge supported, and dowel and mesh reinforced.

In large areas of pavement, or where pavements are subject to significant traffic, a more detailed analysis of the subgrade and traffic conditions should be made. The results of such a study will provide information necessary to design an economical and serviceable pavement.

The recommended thicknesses presented below are considered typical and minimum for the calculated parameters. The client, the owner, and the project principals should be aware that thinner pavement sections might result in increased maintenance costs and lower than anticipated pavement life. The pavement subgrade should be prepared as discussed below.

The PSI recommendation is based on the subgrade soils being prepared to achieve a minimum CBR of three (3). On this basis, it is possible to use a locally typical "standard" pavement section consisting of the following:

RECOMMENDED THICKNESSES (INCHES)		
PAVEMENT MATERIALS *	30,000 EASLS	60,000 EASLS
Asphaltic Surface Course	1½	1½
Asphaltic Binder Course	2	3½
Crushed stone (¾-inch minus)	6	6
Or		
Portland Cement Concrete	4	5
Crushed stone (¾-inch minus)	4	4

*Pavement materials should conform to local and state guidelines, if applicable.

Asphalt Pavement

The granular base course should be built at least two (2) feet wider than the pavement on each side to support the tracks of the slipform paver. This extra width is structurally beneficial for wheel loads applied at the pavement edge. The asphalt base course should be compacted to a minimum of 95% Marshall density according to ASTM D1559.

Asphaltic surface mixture should have a minimum stability of 1,800 pounds and the surface course should be compacted to a minimum of 97% Marshall density according to ASTM D1559. Asphalt mixes should comply with APWA or MODOT specifications.

Asphaltic concrete mix designs and Marshall characteristics should be reviewed to determine if they are consistent with the recommendations given in this report.

Portland Cement Concrete Pavement

Because the pavement at this site will be subjected to freeze-thaw cycles, PSI recommends that an air entrainment admixture be added to the concrete mix to achieve air content in the range of 5% to 7% to provide freeze-thaw durability in the concrete. PSI recommends that a portland cement concrete with a 28-day specified



compressive strength of 4,000 psi should be used. A mixture with a maximum slump of four (4) inches is acceptable. If a water reducing admixture is specified, the slump can be higher. It is recommended that admixtures be submitted to the owner in advance of use in the concrete.

Pavement for any dumpster areas or areas subject to consistent heavy loads should be constructed of Portland cement concrete with load transfer devices installed where construction joints are required. A thickened edge is recommended on the outside of slabs subjected to wheel loads. This thickened edge usually takes the form of an integral curb. Fill material should be compacted behind the curb or the edge of the outside slabs should be thickened. The following are recommended to enhance the quality of the pavement.

- Moisten subgrade just prior to placement of concrete.
- Cure fresh concrete with a liquid membrane-forming curing compound.
- Keep automobile traffic off the slab for three (3) days and truck traffic off the slab for seven (7) days, unless tests are made to determine that the concrete has gained adequate strength (i.e., usually 70% of design strength).

Pavement Subgrade Preparation

Prior to paving, the prepared subgrade should be proof-rolled using a loaded tandem axle dump truck or similar type of pneumatic tired equipment with a minimum gross weight of nine (9) tons per single axle. Localized soft areas identified should be repaired prior to paving. Moisture content of the subgrade should be maintained between -2% and +3% of the optimum at the time of paving. It may require rework when the subgrade is either desiccated or wet. PSI highly recommends that parking and drive subgrade be sloped in a manner to drain water from under the pavement without pocketing or trapping water beneath the pavement. This grading should be accomplished prior to placing the base aggregate.

Construction traffic should be minimized to prevent unnecessary disturbance of the pavement subgrade. Disturbed areas, as verified by PSI, should be removed and replaced with properly compacted material.

The edges of compacted fill should extend a minimum two (2) feet beyond the edges of the pavement, or a distance equal to the depth of fill beneath the pavement, whichever is greater. The measurement should be taken from the outside edge of the pavement to the toe of the excavation prior to sloping.

Pavement Drainage & Maintenance

PSI recommends pavements be sloped to provide rapid surface drainage. Water allowed to pond on or adjacent to the pavement could saturate the subgrade, cause premature deterioration of the pavements, and may require removal and replacement. PSI recommends the subgrade be sloped to drain prior to placing the crushed stone base. Consideration should be given to the use of interceptor drains to collect and remove water collecting in the crushed stone base. The interceptor drains could be incorporated with the storm drains of other utilities located in the pavement areas.

Periodic maintenance of the pavement should be anticipated. This should include sealing of cracks and joints and by maintaining proper surface drainage to avoid ponding of water on or near the pavement areas. Underdrains, sub-drains and underslab drains presented in this report will not prevent moisture vapor that can cause mold growth.



Slopes

The benched placement of engineered structural fill on natural slopes steeper than five (5) horizontal to one (1) vertical where the final area will be uncontained is recommended. The placement of fill should begin at the base of the natural slope with benches or terraces. The benches or terraces should be a minimum of eight (8) feet wide laterally, and should be cut into the slope every five (5) feet of vertical rise. The naturally occurring existing soils should be prepared and fill placed in accordance with the previously described structural fill guidelines. A representative of the geotechnical engineer should monitor the benching and fill placement operations.

Unless specifically designed, temporary slopes shall not exceed steeper than a ratio of two (2) horizontal to one (1) vertical where workers or equipment will occupy space at the toe or of the movement of the excavated slope will jeopardize the stability of an adjacent structure. Temporary slopes exceeding ten (10) feet in vertical height should have a slope stability analysis. Temporary slopes exceeding twenty (20) feet in vertical height should have shear strength testing performed to assess the in-situ strength characteristics.

Permanent cut slopes shall not be excavated to a final grade steeper than a ratio of three (3) horizontal to one (1) vertical without a specific slope stability analysis. Specific shear strength testing should be performed to assess the in-situ strength characteristics for permanent slopes steeper than four (4) horizontal to one (1) vertical.

Special consideration must also be given to the stability of the natural cut ground when supporting substantial fills, to structural fills themselves, and to cut surfaces in natural soil and rock excavations. The evaluation of slope stability aspects of this site and the proposed development is beyond the scope of this exploration. Relatively detailed grading plans will have to be developed before meaningful evaluation of slope stability can be accomplished. All slope stability evaluations should be performed by qualified geotechnical engineering personnel prior to the initiation of any significant grading activities at this site.

CONSTRUCTION CONSIDERATIONS

PSI should be retained to provide observation and testing of construction activities involved in the foundation, earthwork, and related activities of this project. PSI cannot accept responsibility for conditions that deviate from those described in this report, nor for the performance of the foundation system if not engaged to also provide construction observation and testing for this project.

Moisture Sensitive Soils/Weather Related Concerns

The upper fine-grained soils encountered at this site are expected to be sensitive to disturbances caused by construction traffic and to changes in moisture content. During wet weather periods, increases in the moisture content of the soil can cause significant reduction in the soil strength and support capabilities. In addition, soils that become wet may be slow to dry and thus significantly retard the progress of grading and compaction activities. It will, therefore, be advantageous to perform earthwork and foundation construction activities during dry weather.

Drainage and Groundwater Considerations

PSI recommends that the Contractor determine the actual groundwater levels at the site at the time of the construction activities to assess the impact groundwater may have on construction. Water should not be allowed to collect in the foundation excavation, on floor slab areas, or on prepared subgrades of the construction area either during or after construction. Undercut or excavated areas should be sloped toward one corner to facilitate removal of collected rainwater, groundwater, or surface runoff. Positive site drainage should be provided to



reduce infiltration of surface water around the perimeter of the building and beneath the floor slabs. The grades should be sloped away from the building and surface drainage should be collected and discharged such that water is not permitted to infiltrate the backfill and floor slab areas of the building.

Excavations

In Federal Register, Volume 54, Number 209 (October 1989), the United States Department of Labor, Occupational Safety and Health Administration (OSHA) amended its "Construction Standards for Excavations, 29 CFR, part 1926, Subpart P". This document was issued to better enhance the safety of workers entering trenches or excavations. It is mandated by this federal regulation that excavations, whether they be utility trenches, basement excavation or footing excavations, be constructed in accordance with the new OSHA guidelines. It is PSI's understanding that these regulations are being strictly enforced and if they are not closely followed, the owner and the contractor could be liable for substantial penalties.

The contractor is solely responsible for designing and constructing stable, temporary excavations and should shore, slope, or bench the sides of the excavations as required to maintain stability of both the excavation sides and bottom. The contractor's "responsible person", as defined in 29 CFR Part 1926, should evaluate the soil exposed in the excavations as part of the contractor's safety procedures. In no case should slope height, slope inclination, or excavation depth, including utility trench excavation depth, exceed those specified in local, state, and federal safety regulations.

PSI is providing this information solely as a service to our client. PSI does not assume responsibility for construction site safety or the contractor's or other parties' compliance with local, state, and federal safety or other regulations.

GEOTECHNICAL RISK

The concept of risk is an important aspect of the geotechnical evaluation. The primary reason for this is that the analytical methods used to develop geotechnical recommendations do not comprise an exact science. The analytical tools which geotechnical engineers use are generally empirical and must be used in conjunction with engineering judgment and experience. Therefore, the solutions and recommendations presented in the geotechnical evaluation should not be considered risk-free and, more importantly, are not a guarantee that the interaction between the soils and the proposed construction will perform as planned. The engineering recommendations presented in the preceding section constitutes PSI's professional estimate of those measures that are necessary for the proposed improvements to perform according to the proposed design based on the information generated and referenced during this evaluation, and PSI's experience in working with these conditions.

REPORT LIMITATIONS

The recommendations submitted are based on the available subsurface information obtained by PSI and design details furnished by Carlson Consulting Engineers. If there are revisions to the plans for this project or if deviations from the subsurface conditions noted in this report are encountered during construction, PSI should be notified immediately to determine if changes in the recommendations are required. If PSI is not retained to perform these functions, PSI will not be responsible for the impact of those conditions on the project.




The geotechnical engineer warrants that the findings, recommendations, specifications, or professional advice contained herein have been made in accordance with generally accepted professional geotechnical engineering practices in the local area. No other warranties are implied or expressed.

After the plans and specifications are more complete, the geotechnical engineer should be retained and provided the opportunity to review the final design plans and specifications to check that our engineering recommendations have been properly incorporated into the design documents. At that time, it may be necessary to submit supplementary recommendations. This report has been prepared for the exclusive use of Carlson Consulting Engineers and their consultants for the specific application to the Proposed Cottages at Generation Village project located on Buck Road near Megan Lane in Willard, Missouri.



APPENDIX A - TOPOGRAPHIC MAP

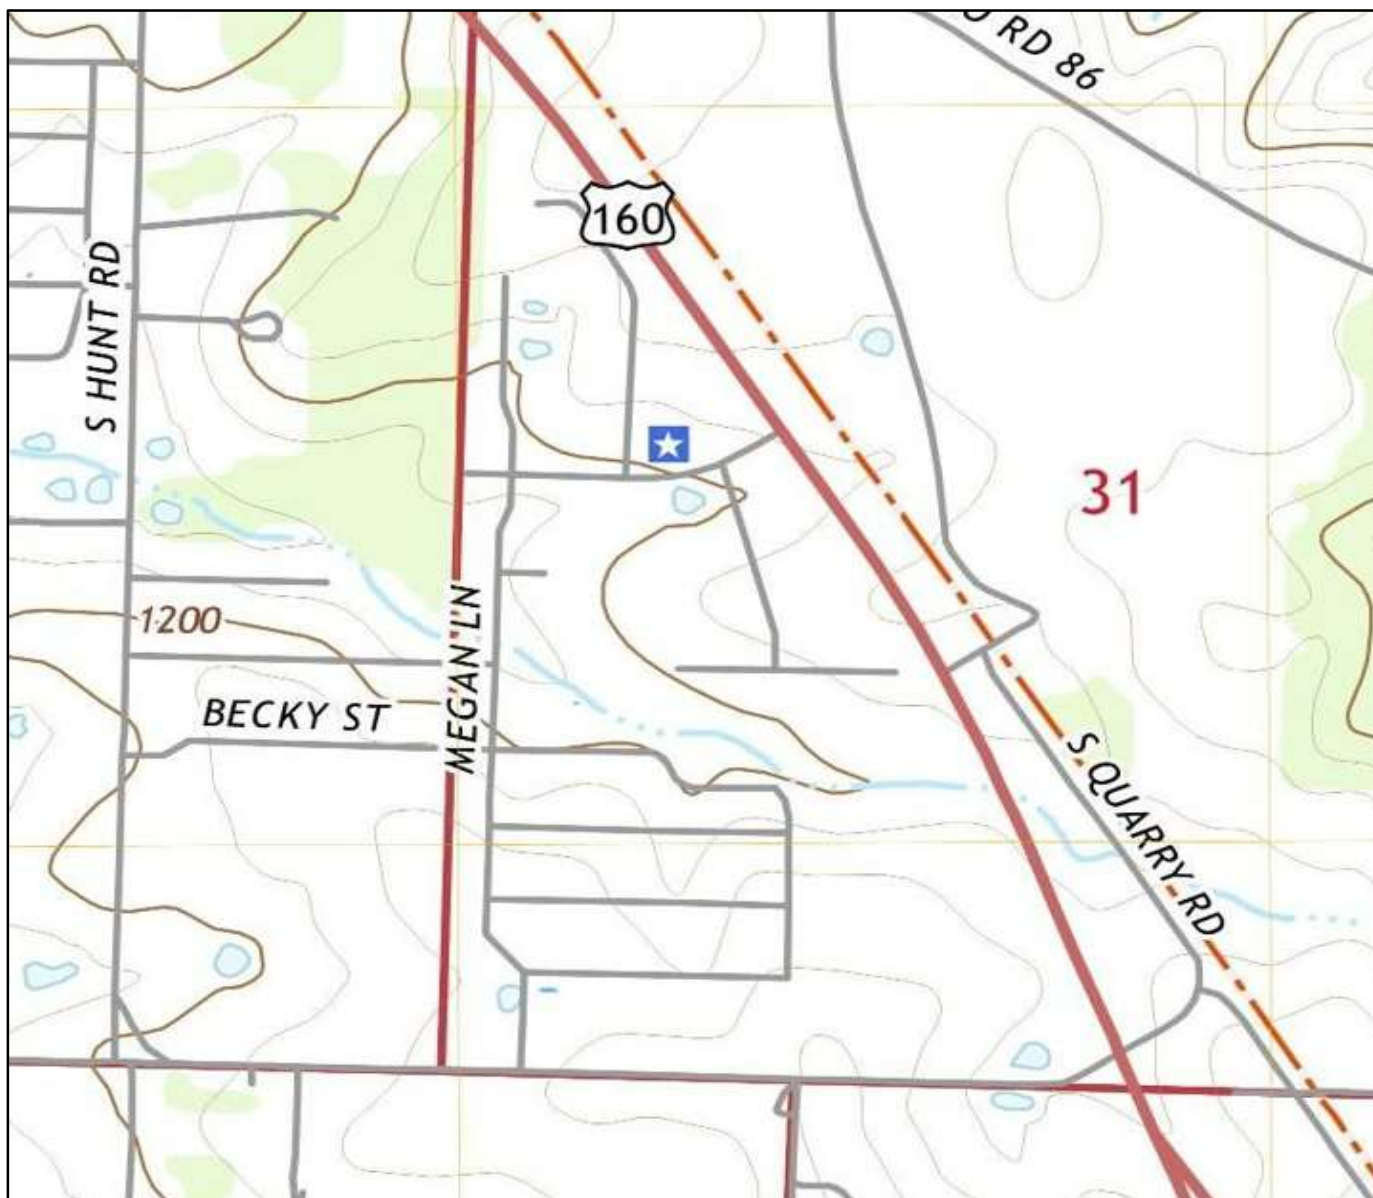

Topographic Drawing
Cottages at Generations Village
Magan Lane and Wright Street
Willard, MO

Intertek-PSI Project No.:

338-2353

Drawn By:
DMW



APPENDIX B - SITE VICINITY MAP

Intertek-PSI



Site Vicinity Plan
Cottages at Generations Village
Magan Lane and Wright Street
Willard, MO

Intertek-PSI Project No.:

338-2353

Aerial Year:

2021

Drawn By:

Drawing Date:

2/21/22

DMW



APPENDIX C – BORING LOCATION PLAN

Intertek-PSI



Boring Location Diagram
Cottages at Generations Village
Magan Lane and Wright Street
Willard, MO

Intertek-PSI Project No.:

338-2353


Date:
2/21/2022


Drawn By:
DMW



APPENDIX D – BORING LOGS

DATE STARTED: 3/22/22		DRILL COMPANY: PSI, Inc.		BORING B-01	
DATE COMPLETED: 3/22/22		DRILLER: SD LOGGED BY: LN			
COMPLETION DEPTH: 3.0 ft		DRILL RIG: CME-55LC		<div style="display: flex; align-items: center;"> <div style="border: 1px solid black; padding: 2px; margin-right: 5px;">Water</div> <div style="display: flex; flex-direction: column; gap: 5px;"> <div><input type="checkbox"/> While Drilling not observed</div> <div><input type="checkbox"/> Upon Completion not observed</div> <div><input type="checkbox"/> Delay N/A</div> </div> </div>	
BENCHMARK: N/A		DRILLING METHOD: Hollow Stem Auger			
ELEVATION: N/A		SAMPLING METHOD: SS			
LATITUDE:		HAMMER TYPE: Automatic		BORING LOCATION:	
LONGITUDE:		EFFICIENCY: 84%			
STATION: N/A OFFSET: N/A		REVIEWED BY: DW			
REMARKS: N ₆₀ denotes the normalization to 60% efficiency as described in ASTM D4633.					

Elevation (feet)	Depth, (feet)	Graphic Log	Sample Type	Sample No.	Recovery (inches)	MATERIAL DESCRIPTION	USCS Classification	SPT Blows per 6-inch (SS)	Moisture, %	STANDARD PENETRATION TEST DATA N in blows/ft ©	Additional Remarks
<div style="display: flex; justify-content: space-between; font-size: 0.8em;"> <div> X Moisture PL + LL </div> <div> 0 25 50 </div> </div> <div style="display: flex; justify-content: space-between; font-size: 0.8em; margin-top: 5px;"> <div> ▲ Qu * Qp </div> <div> 0 2.0 4.0 </div> </div>											
	0			1	16	ORGANIC LAYER ~ 3 INCHES FILL - HIGH PLASTICITY CLAY - red brown, with rock Fill - high plasticity clay, red brown and gray Auger refusal at 3 feet	CH	2-4-6 N ₆₀ =14	31	<div style="display: flex; justify-content: space-around;"> <div>©</div> <div>X</div> </div>	

	Professional Service Industries, Inc.	PROJECT NO.: 338-2353
	2828 S. 44th Street	PROJECT: Cottages at Generations West
	Kansas City, KS 66106	LOCATION: Buck Road near Megan Lane
	Telephone: (913) 310-1600	Willard, Missouri

DATE STARTED: 3/21/22	DRILL COMPANY: PSI, Inc.	<h2 style="margin:0;">BORING B-02</h2>
DATE COMPLETED: 3/21/22	DRILLER: SD LOGGED BY: LN	
COMPLETION DEPTH: 9.0 ft	DRILL RIG: CME-55LC	<div style="display: flex; align-items: center;"> <div style="width: 20px; height: 20px; border: 1px solid black; margin-right: 5px;"></div> <div style="font-size: 0.8em;"> While Drilling not observed Upon Completion not observed Delay N/A </div> </div>
BENCHMARK: N/A	DRILLING METHOD: Hollow Stem Auger	
ELEVATION: N/A	SAMPLING METHOD: SS/ ST	
LATITUDE:	HAMMER TYPE: Automatic	BORING LOCATION:
LONGITUDE:	EFFICIENCY: 84%	
STATION: N/A OFFSET: N/A	REVIEWED BY: DW	
REMARKS: N ₆₀ denotes the normalization to 60% efficiency as described in ASTM D4633.		

Elevation (feet)	Depth, (feet)	Graphic Log	Sample Type	Sample No.	Recovery (inches)	MATERIAL DESCRIPTION	USCS Classification	SPT Blows per 6-inch (SS) Push Pressure (ST)	Moisture, %	STANDARD PENETRATION TEST DATA N in blows/ft @	Additional Remarks
										<div> <div> <div>×</div> Moisture <div>■ PL</div> <div>⊕ LL</div> </div> <div> <div>▲ Qu</div> <div>✱ Qp</div> </div> </div>	
	0					ORGANIC LAYER ~ 3 INCHES					
				1	10	FILL - HIGH PLASTICITY CLAY - brown, with rock and asphalt	CH	24-8-5 N ₆₀ =18	7		
				2	14	HIGH PLASTICITY CLAY - reddish brown and gray, with rock	CH	8-5-4 N ₆₀ =13	48		
	5			3	24				42		DD = 74 pcf Sat.=91% Q _u = 0.7 tsf
				4	6	WEATHERED CHERT Auger refusal at 9 feet		50/6	51		

	Professional Service Industries, Inc.	PROJECT NO.: 338-2353
	2828 S. 44th Street	PROJECT: Cottages at Generations West
	Kansas City, KS 66106	LOCATION: Buck Road near Megan Lane
	Telephone: (913) 310-1600	Willard, Missouri

DATE STARTED: 3/8/22
 DATE COMPLETED: 3/8/22
 COMPLETION DEPTH: 10.5 ft
 BENCHMARK: N/A
 ELEVATION: N/A
 LATITUDE:
 LONGITUDE:
 STATION: N/A OFFSET: N/A
 REMARKS: N_{60} denotes the normalization to 60% efficiency as described in ASTM D4633.

DRILL COMPANY: PSI, Inc.
 DRILLER: SD LOGGED BY: LN
 DRILL RIG: CME-55LC
 DRILLING METHOD: Hollow Stem Auger
 SAMPLING METHOD: SS
 HAMMER TYPE: Automatic
 EFFICIENCY: 84%
 REVIEWED BY: DW

BORING B-03

Water: ☒ While Drilling not observed
☒ Upon Completion not observed
☒ Delay N/A

BORING LOCATION:

Elevation (feet)	Depth, (feet)	Graphic Log	Sample Type	Sample No.	Recovery (inches)	MATERIAL DESCRIPTION	USCS Classification	SPT Blows per 6-inch (SS)	Moisture, %	STANDARD PENETRATION TEST DATA N in blows/ft @	Additional Remarks
										X Moisture <input checked="" type="checkbox"/> PL <input checked="" type="checkbox"/> LL STRENGTH, tsf ▲ Qu * Qp	
0						ORGANIC LAYER ~ 4 INCHES					
				1	7	FILL - HIGH PLASTICITY CLAY - brown and red brown, with rock and asphalt	CH	3-3-2 $N_{60}=7$	17		
				2	2			2-2-2 $N_{60}=6$	35		
5				3	18	HIGH PLASTICITY CLAY - reddish brown and gray	CH	2-3-9 $N_{60}=17$	30		
				4	16	High plasticity clay, reddish brown with weathered limestone and chert		3-3-4 $N_{60}=10$	35		
10						Auger refusal at 10½ feet					



Professional Service Industries, Inc.
 2828 S. 44th Street
 Kansas City, KS 66106
 Telephone: (913) 310-1600

PROJECT NO.: 338-2353
 PROJECT: Cottages at Generations West
 LOCATION: Buck Road near Megan Lane
 Willard, Missouri


DATE STARTED: 3/8/22
 DATE COMPLETED: 3/8/22
 COMPLETION DEPTH: 23.0 ft
 BENCHMARK: N/A
 ELEVATION: N/A
 LATITUDE:
 LONGITUDE:
 STATION: N/A OFFSET: N/A

DRILL COMPANY: PSI, Inc.
 DRILLER: SD LOGGED BY: LN
 DRILL RIG: CME-55LC
 DRILLING METHOD: Hollow Stem Auger
 SAMPLING METHOD: SS/ ST
 HAMMER TYPE: Automatic
 EFFICIENCY: 84%
 REVIEWED BY: DW

BORING B-04

Water
 ▽ While Drilling 17 feet
 ▼ Upon Completion 10 feet
 ▽ Delay N/A

BORING LOCATION:

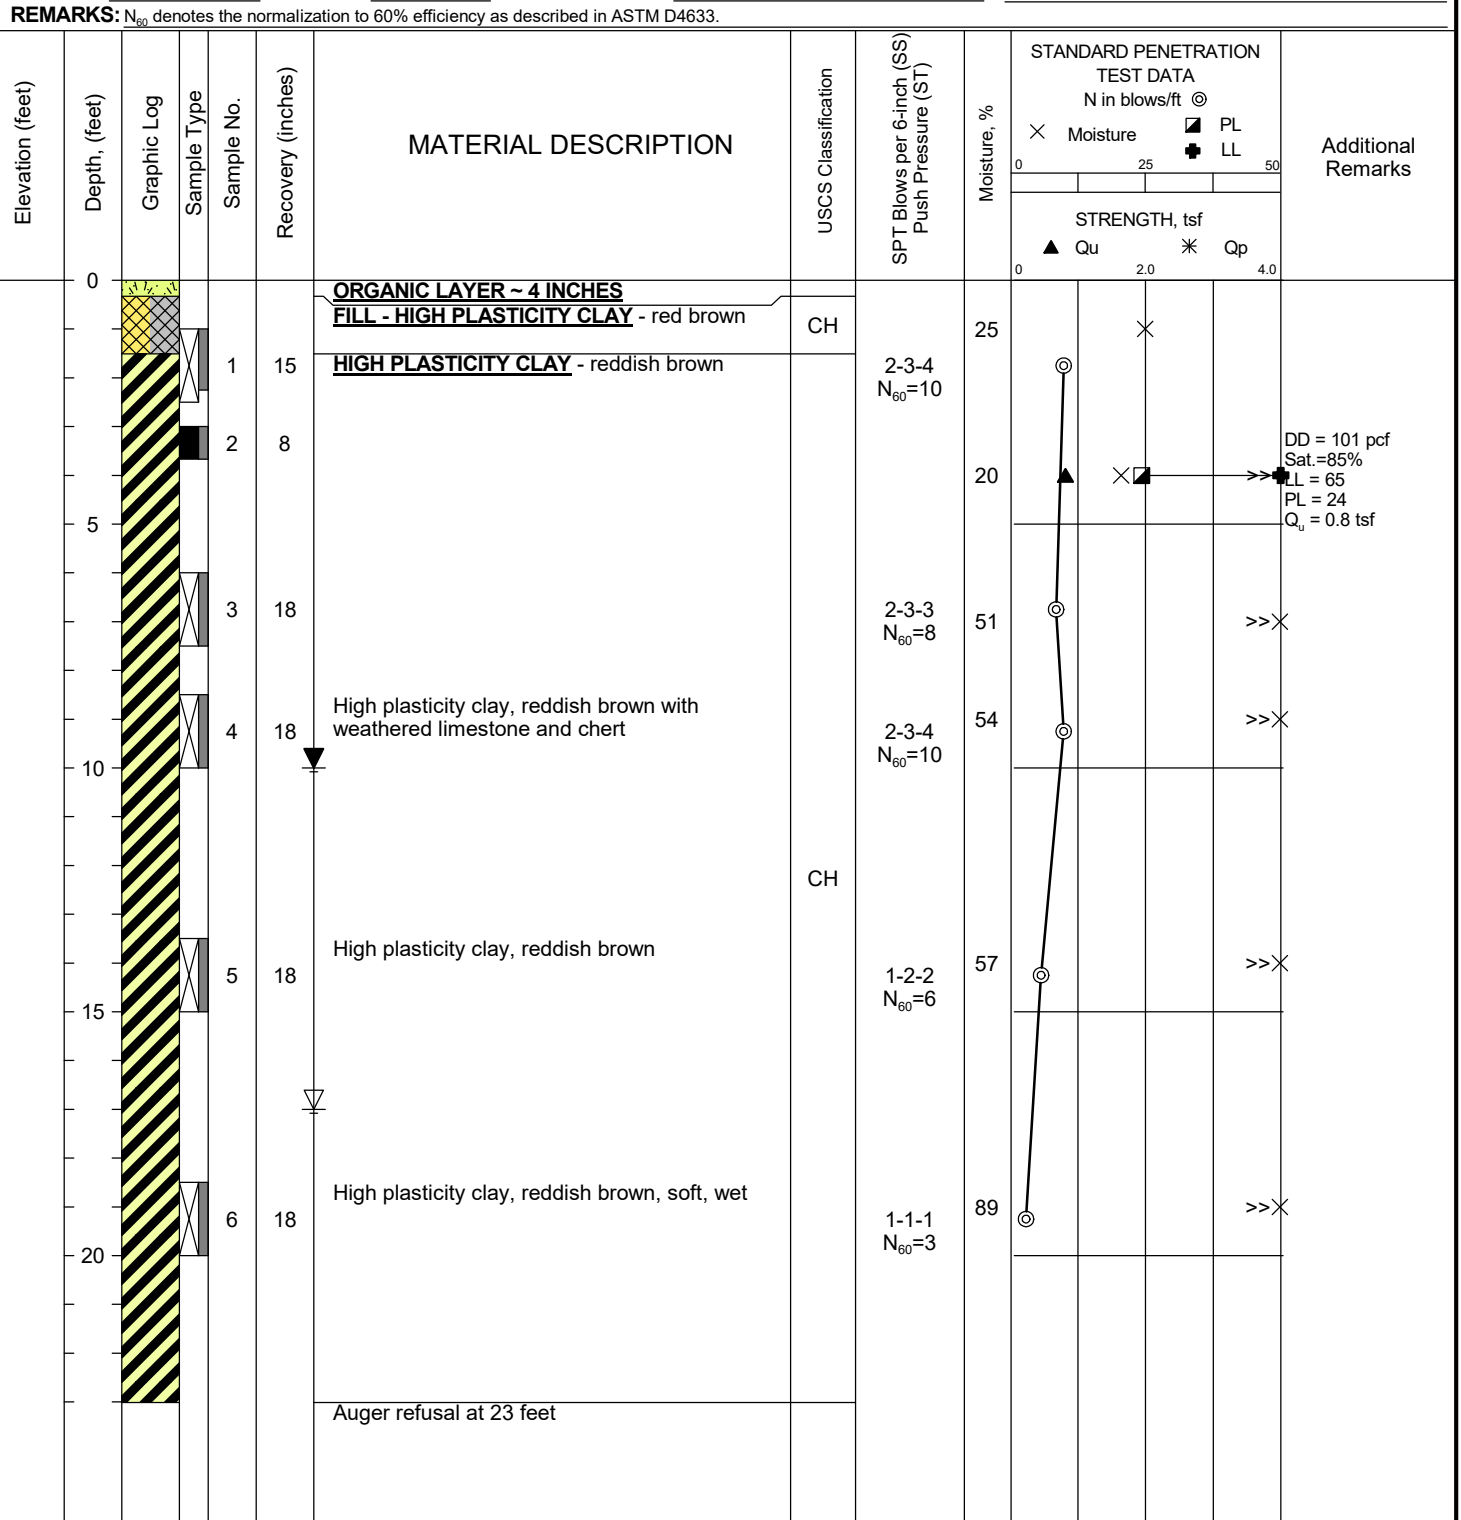

Professional Service Industries, Inc.
 2828 S. 44th Street
 Kansas City, KS 66106
 Telephone: (913) 310-1600

PROJECT NO.: 338-2353
 PROJECT: Cottages at Generations West
 LOCATION: Buck Road near Megan Lane
 Willard, Missouri

DATE STARTED: 3/22/22	DRILL COMPANY: PSI, Inc.	BORING B-05	
DATE COMPLETED: 3/22/22	DRILLER: SD LOGGED BY: LN		
COMPLETION DEPTH: 6.0 ft	DRILL RIG: CME-55LC		
BENCHMARK: N/A	DRILLING METHOD: Hollow Stem Auger		
ELEVATION: N/A	SAMPLING METHOD: SS		
LATITUDE: _____	HAMMER TYPE: Automatic		
LONGITUDE: _____	EFFICIENCY: 84%	<div style="display: flex; align-items: center;"> <div style="writing-mode: vertical-rl; transform: rotate(180deg); font-weight: bold; margin-right: 5px;">Water</div> <div style="margin-right: 10px;"> <input type="checkbox"/> While Drilling <input checked="" type="checkbox"/> Upon Completion <input type="checkbox"/> Delay </div> <div> not observed not observed N/A </div> </div>	
STATION: N/A OFFSET: N/A	REVIEWED BY: DW		BORING LOCATION: _____
REMARKS: N ₆₀ denotes the normalization to 60% efficiency as described in ASTM D4633.			

Elevation (feet)	Depth, (feet)	Graphic Log	Sample Type	Sample No.	Recovery (inches)	MATERIAL DESCRIPTION	USCS Classification	SPT Blows per 6-inch (SS)	Moisture, %	STANDARD PENETRATION TEST DATA N in blows/ft @				Additional Remarks
										<div> <div> <div>×</div> <div>Moisture</div> </div> <div> <div>▣</div> <div>PL</div> </div> <div> <div>+</div> <div>LL</div> </div> </div> <div> <div>0</div> <div>25</div> <div>50</div> </div>				
	0					ORGANIC LAYER ~ 4 INCHES								
						FILL - HIGH PLASTICITY CLAY - brown	CH							
				1	15	HIGH PLASTICITY CLAY - reddish brown	CH	2-3-12 N ₆₀ =21	27					
						CHERTY HIGH PLASTICITY CLAY - reddish brown								
				2	8	HIGH PLASTICITY CLAY - reddish brown, with chert	CH	2-9-5 N ₆₀ =20	32					
	5					Auger refusal at 6 feet								


	Professional Service Industries, Inc. 2828 S. 44th Street Kansas City, KS 66106 Telephone: (913) 310-1600	PROJECT NO.: 338-2353
		PROJECT: Cottages at Generations West
		LOCATION: Buck Road near Megan Lane
		Willard, Missouri

DATE STARTED: 3/21/22		DRILL COMPANY: PSI, Inc.		BORING B-06	
DATE COMPLETED: 3/21/22		DRILLER: SD LOGGED BY: LN			
COMPLETION DEPTH: 3.5 ft		DRILL RIG: CME-55LC		<div style="display: flex; align-items: center;"> <div style="border: 1px solid black; padding: 2px; margin-right: 5px;">Water</div> <div style="display: flex; flex-direction: column; gap: 5px;"> <div><input type="checkbox"/> While Drilling not observed</div> <div><input checked="" type="checkbox"/> Upon Completion not observed</div> <div><input checked="" type="checkbox"/> Delay N/A</div> </div> </div>	
BENCHMARK: N/A		DRILLING METHOD: Hollow Stem Auger			
ELEVATION: N/A		SAMPLING METHOD: SS			
LATITUDE:		HAMMER TYPE: Automatic		BORING LOCATION:	
LONGITUDE:		EFFICIENCY: 84%			
STATION: N/A OFFSET: N/A		REVIEWED BY: DW			
REMARKS: N_{60} denotes the normalization to 60% efficiency as described in ASTM D4633.					

Elevation (feet)	Depth, (feet)	Graphic Log	Sample Type	Sample No.	Recovery (inches)	MATERIAL DESCRIPTION	USCS Classification	SPT Blows per 6-inch (SS)	Moisture, %	STANDARD PENETRATION TEST DATA	Additional Remarks
0				1		ORGANIC LAYER ~ 4 INCHES HIGH PLASTICITY CLAY - reddish brown, with rock High plasticity clay, reddish brown, very cherty High plasticity clay, reddish brown, with chert Auger refusal at 6 feet	CH	4-6-10 $N_{60}=22$	19	STANDARD PENETRATION TEST DATA N in blows/ft @ <div style="display: flex; justify-content: space-between; margin-top: 5px;"> <div> X Moisture ▲ Qu ◎ </div> <div> PL LL * Qp </div> </div>	LL = 75 PL = 24

	Professional Service Industries, Inc. 2828 S. 44th Street Kansas City, KS 66106 Telephone: (913) 310-1600	PROJECT NO.: 338-2353 PROJECT: Cottages at Generations West LOCATION: Buck Road near Megan Lane Willard, Missouri
--	--	--

DATE STARTED: 3/21/22	DRILL COMPANY: PSI, Inc.	BORING B-07	
DATE COMPLETED: 3/21/22	DRILLER: SD LOGGED BY: LN		
COMPLETION DEPTH: 3.5 ft	DRILL RIG: CME-55LC		
BENCHMARK: N/A	DRILLING METHOD: Hollow Stem Auger		
ELEVATION: N/A	SAMPLING METHOD: SS		
LATITUDE:	HAMMER TYPE: Automatic		
LONGITUDE:	EFFICIENCY: 84%	<div style="display: flex; align-items: center;"> <div style="writing-mode: vertical-rl; transform: rotate(180deg); font-weight: bold; margin-right: 5px;">Water</div> <div style="margin-right: 10px;"> <input type="checkbox"/> While Drilling <input checked="" type="checkbox"/> Upon Completion <input type="checkbox"/> Delay </div> <div> not observed not observed N/A </div> </div>	
STATION: N/A OFFSET: N/A	REVIEWED BY: DW		BORING LOCATION:
REMARKS: N ₆₀ denotes the normalization to 60% efficiency as described in ASTM D4633.			

Elevation (feet)	Depth, (feet)	Graphic Log	Sample Type	Sample No.	Recovery (inches)	MATERIAL DESCRIPTION	USCS Classification	SPT Blows per 6-inch (SS)	Moisture, %	STANDARD PENETRATION TEST DATA N in blows/ft ©				Additional Remarks
	0			1	6	ORGANIC LAYER ~ 4 INCHES FILL - HIGH PLASTICITY CLAY - red brown with rock WEATHERED CHERT	CH	2-50/3	30	<input checked="" type="checkbox"/> Moisture	<input checked="" type="checkbox"/> PL	<input checked="" type="checkbox"/> LL		
							CH							
						Auger refusal at 3½ feet								


	Professional Service Industries, Inc.	PROJECT NO.: 338-2353
	2828 S. 44th Street	PROJECT: Cottages at Generations West
	Kansas City, KS 66106	LOCATION: Buck Road near Megan Lane
	Telephone: (913) 310-1600	Willard, Missouri

DATE STARTED: 3/22/22	DRILL COMPANY: PSI, Inc.	BORING B-08
DATE COMPLETED: 3/22/22	DRILLER: SD LOGGED BY: LN	
COMPLETION DEPTH: 4.5 ft	DRILL RIG: CME-55LC	<div style="display: flex; align-items: center;"> <div style="writing-mode: vertical-rl; transform: rotate(180deg); font-weight: bold; margin-right: 5px;">Water</div> <div style="margin-right: 10px;"> <input type="checkbox"/> While Drilling <input checked="" type="checkbox"/> Upon Completion <input checked="" type="checkbox"/> Delay </div> <div> not observed not observed N/A </div> </div>
BENCHMARK: N/A	DRILLING METHOD: Hollow Stem Auger	
ELEVATION: N/A	SAMPLING METHOD: SS	
LATITUDE:	HAMMER TYPE: Automatic	BORING LOCATION:
LONGITUDE:	EFFICIENCY: 84%	
STATION: N/A OFFSET: N/A	REVIEWED BY: DW	
REMARKS: N ₆₀ denotes the normalization to 60% efficiency as described in ASTM D4633.		




Elevation (feet)	Depth, (feet)	Graphic Log	Sample Type	Sample No.	Recovery (inches)	MATERIAL DESCRIPTION	USCS Classification	SPT Blows per 6-inch (SS)	Moisture, %	STANDARD PENETRATION TEST DATA N in blows/ft ©	Additional Remarks
	0					ORGANIC LAYER ~ 4 INCHES					
						FILL - HIGH PLASTICITY CLAY - brown	CH				
						HIGH PLASTICITY CLAY - red brown	CH	2-4-5 N ₆₀ =13	27		
				1	15						
						WEATHERED CHERT	CH	30-50/6	4		
				2	12	Spoon refusal at approximately 4½ feet					

	Professional Service Industries, Inc.	PROJECT NO.: 338-2353
	2828 S. 44th Street	PROJECT: Cottages at Generations West
	Kansas City, KS 66106	LOCATION: Buck Road near Megan Lane
	Telephone: (913) 310-1600	Willard, Missouri

DATE STARTED: 3/21/22	DRILL COMPANY: PSI, Inc.	BORING B-09										
DATE COMPLETED: 3/21/22	DRILLER: SD LOGGED BY: LN											
COMPLETION DEPTH: 2.5 ft	DRILL RIG: CME-55LC	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td rowspan="3" style="width: 5%; text-align: center; vertical-align: middle;">Water</td> <td style="width: 5%; text-align: center;">▽</td> <td style="width: 45%;">While Drilling</td> <td style="width: 45%;">not observed</td> </tr> <tr> <td style="text-align: center;">▼</td> <td>Upon Completion</td> <td>not observed</td> </tr> <tr> <td style="text-align: center;">▽</td> <td>Delay</td> <td>N/A</td> </tr> </table>	Water	▽	While Drilling	not observed	▼	Upon Completion	not observed	▽	Delay	N/A
Water	▽			While Drilling	not observed							
	▼			Upon Completion	not observed							
	▽	Delay	N/A									
BENCHMARK: N/A	DRILLING METHOD: Hollow Stem Auger	BORING LOCATION:										
ELEVATION: N/A	SAMPLING METHOD: SS											
LATITUDE:	HAMMER TYPE: Automatic											
LONGITUDE:	EFFICIENCY: 84%											
STATION: N/A OFFSET: N/A	REVIEWED BY: DW											
REMARKS: N ₆₀ denotes the normalization to 60% efficiency as described in ASTM D4633.												

Elevation (feet)	Depth, (feet)	Graphic Log	Sample Type	Sample No.	Recovery (inches)	MATERIAL DESCRIPTION	USCS Classification	SPT Blows per 6-inch (SS)	Moisture, %	STANDARD PENETRATION TEST DATA N in blows/ft © X Moisture PL LL STRENGTH, tsf ▲ Qu * Qp	Additional Remarks
	0			1	9	<u>ORGANIC LAYER ~ 6 INCHES</u> <u>FILL - HIGH PLASTICITY CLAY</u> - brown and olive gray with rock <u>WEATHERED CHERT</u> Auger refusal at 2½ feet	CH CH	4-4-50/4	14	X ■ >>> ● LL = 58 © PL = 24	

	Professional Service Industries, Inc.	PROJECT NO.: 338-2353
	2828 S. 44th Street	PROJECT: Cottages at Generations West
	Kansas City, KS 66106	LOCATION: Buck Road near Megan Lane
	Telephone: (913) 310-1600	Willard, Missouri

Water		While Drilling	not observed
		Upon Completion	not observed
		Delay	N/A

STANDARD PENETRATION
TEST DATA

N in blows/ft ☉

✕ Moisture ▣ PL
 ⊕ LL

0 25 50

STRENGTH, tsf

▲ Qu ✱ Qp

0 2.0 4.0


intertek
psi

DATE STARTED: 3/8/22	DRILL COMPANY: PSI, Inc.	BORING B-11
DATE COMPLETED: 3/8/22	DRILLER: SD LOGGED BY: LN	
COMPLETION DEPTH: 10.0 ft	DRILL RIG: CME-55LC	<div style="display: flex; align-items: center;"> <div style="width: 20px; text-align: center; font-weight: bold;">Water</div> <div style="margin-left: 10px;"> <div style="display: flex; align-items: center;"> <div style="width: 10px; height: 10px; border: 1px solid black; margin-right: 5px;"></div> While Drilling </div> <div style="display: flex; align-items: center;"> <div style="width: 10px; height: 10px; border: 1px solid black; margin-right: 5px;"></div> Upon Completion </div> <div style="display: flex; align-items: center;"> <div style="width: 10px; height: 10px; border: 1px solid black; margin-right: 5px;"></div> Delay </div> </div> <div style="margin-left: 20px;"> <div>not observed</div> <div>not observed</div> <div>N/A</div> </div> </div>
BENCHMARK: N/A	DRILLING METHOD: Hollow Stem Auger	
ELEVATION: N/A	SAMPLING METHOD: SS	
LATITUDE:	HAMMER TYPE: Automatic	BORING LOCATION:
LONGITUDE:	EFFICIENCY: 84%	
STATION: N/A OFFSET: N/A	REVIEWED BY: DW	
REMARKS: N ₆₀ denotes the normalization to 60% efficiency as described in ASTM D4633.		

Elevation (feet)	Depth, (feet)	Graphic Log	Sample Type	Sample No.	Recovery (inches)	MATERIAL DESCRIPTION	USCS Classification	SPT Blows per 6-inch (SS)	Moisture, %	STANDARD PENETRATION TEST DATA N in blows/ft ©	Additional Remarks
										<div> <div> <div>×</div>Moisture <div>■</div>PL <div>+</div>LL </div> <div> <div>▲</div>Qu <div>✱</div>Qp </div> </div>	
0						ORGANIC LAYER ~ 3 INCHES					
				1	8	FILL - HIGH PLASTICITY CLAY - brown and reddish brown with rock	CH	2-3-4 N ₆₀ =10	22		
				2	16	HIGH PLASTICITY CLAY - reddish brown		2-3-4 N ₆₀ =10	37		
	5			3	18		CH	3-5-5 N ₆₀ =14	25		
				4	18	High plasticity clay, reddish brown with weathered chert		12-14-14 N ₆₀ =39	23		
10						Auger refusal at 10 feet					

	Professional Service Industries, Inc.	PROJECT NO.: 338-2353
	2828 S. 44th Street	PROJECT: Cottages at Generations West
	Kansas City, KS 66106	LOCATION: Buck Road near Megan Lane
	Telephone: (913) 310-1600	Willard, Missouri

DATE STARTED: 3/21/22	DRILL COMPANY: PSI, Inc.	BORING B-12										
DATE COMPLETED: 3/21/22	DRILLER: SD LOGGED BY: LN											
COMPLETION DEPTH: 2.5 ft	DRILL RIG: CME-55LC	<table border="1" style="width: 100%; border-collapse: collapse;"> <tr> <td rowspan="3" style="width: 5%; text-align: center; vertical-align: middle;">Water</td> <td style="width: 5%; text-align: center;">▽</td> <td style="width: 45%;">While Drilling</td> <td style="width: 45%;">not observed</td> </tr> <tr> <td style="text-align: center;">▼</td> <td>Upon Completion</td> <td>not observed</td> </tr> <tr> <td style="text-align: center;">▽</td> <td>Delay</td> <td>N/A</td> </tr> </table>	Water	▽	While Drilling	not observed	▼	Upon Completion	not observed	▽	Delay	N/A
Water	▽			While Drilling	not observed							
	▼			Upon Completion	not observed							
	▽	Delay	N/A									
BENCHMARK: N/A	DRILLING METHOD: Hollow Stem Auger	BORING LOCATION:										
ELEVATION: N/A	SAMPLING METHOD: SS											
LATITUDE:	HAMMER TYPE: Automatic											
LONGITUDE:	EFFICIENCY: 84%											
STATION: N/A OFFSET: N/A	REVIEWED BY: DW											
REMARKS: N ₆₀ denotes the normalization to 60% efficiency as described in ASTM D4633.												

Elevation (feet)	Depth, (feet)	Graphic Log	Sample Type	Sample No.	Recovery (inches)	MATERIAL DESCRIPTION	USCS Classification	SPT Blows per 6-inch (SS)	Moisture, %	STANDARD PENETRATION TEST DATA N in blows/ft ©	Additional Remarks
	0			1	6	<div>ORGANIC LAYER ~ 3 INCHES</div> <div>FILL - HIGH PLASTICITY CLAY - brown and reddish brown with rock</div> <div>WEATHERED CHERT</div> <div>Auger refusal at 2½ feet</div>	CH	3-6-50/4	19	<div> <div> <div>×</div> <div>Moisture</div> </div> <div> <div>■</div> <div>PL</div> </div> <div> <div>+</div> <div>LL</div> </div> </div> <div> <div>▲</div> <div>Qu</div> </div> <div> <div>✱</div> <div>Qp</div> </div>	

	Professional Service Industries, Inc.	PROJECT NO.: 338-2353
	2828 S. 44th Street	PROJECT: Cottages at Generations West
	Kansas City, KS 66106	LOCATION: Buck Road near Megan Lane
	Telephone: (913) 310-1600	Willard, Missouri



APPENDIX E – GENERAL NOTES/SOIL CLASSIFICATION CHART



GENERAL NOTES

SAMPLE IDENTIFICATION

The Unified Soil Classification System (USCS), AASHTO 1988 and ASTM designations D2487 and D-2488 are used to identify the encountered materials unless otherwise noted. Coarse-grained soils are defined as having more than 50% of their dry weight retained on a #200 sieve (0.075mm); they are described as: boulders, cobbles, gravel or sand. Fine-grained soils have less than 50% of their dry weight retained on a #200 sieve; they are defined as silts or clay depending on their Atterberg Limit attributes. Major constituents may be added as modifiers and minor constituents may be added according to the relative proportions based on grain size.

DRILLING AND SAMPLING SYMBOLS

SFA: Solid Flight Auger - typically 4" diameter flights, except where noted.	SS: Split-Spoon - 1 3/8" I.D., 2" O.D., except where noted.
HSA: Hollow Stem Auger - typically 3 1/4" or 4 1/4" I.D. openings, except where noted.	ST: Shelby Tube - 3" O.D., except where noted.
M.R.: Mud Rotary - Uses a rotary head with Bentonite or Polymer Slurry	BS: Bulk Sample
R.C.: Diamond Bit Core Sampler	PM: Pressuremeter
H.A.: Hand Auger	CPT-U: Cone Penetrometer Testing with Pore-Pressure Readings
P.A.: Power Auger - Handheld motorized auger	

SOIL PROPERTY SYMBOLS

N: Standard "N" penetration: Blows per foot of a 140 pound hammer falling 30 inches on a 2-inch O.D. Split-Spoon.
N ₆₀ : A "N" penetration value corrected to an equivalent 60% hammer energy transfer efficiency (ETR)
Q _u : Unconfined compressive strength, TSF
Q _p : Pocket penetrometer value, unconfined compressive strength, TSF
w%: Moisture/water content, %
LL: Liquid Limit, %
PL: Plastic Limit, %
PI: Plasticity Index = (LL-PL), %
DD: Dry unit weight, pcf
▽, ▽, ▼ Apparent groundwater level at time noted

RELATIVE DENSITY OF COARSE-GRAINED SOILS

ANGULARITY OF COARSE-GRAINED PARTICLES

Relative Density	N - Blows/foot	Description	Criteria
Very Loose	0 - 4	Angular:	Particles have sharp edges and relatively plane sides with unpolished surfaces
Loose	4 - 10	Subangular:	Particles are similar to angular description, but have rounded edges
Medium Dense	10 - 30	Subrounded:	Particles have nearly plane sides, but have well-rounded corners and edges
Dense	30 - 50	Rounded:	Particles have smoothly curved sides and no edges
Very Dense	50 - 80		
Extremely Dense	80+		

GRAIN-SIZE TERMINOLOGY

Component	Size Range
Boulders:	Over 300 mm (>12 in.)
Cobbles:	75 mm to 300 mm (3 in. to 12 in.)
Coarse-Grained Gravel:	19 mm to 75 mm (3/4 in. to 3 in.)
Fine-Grained Gravel:	4.75 mm to 19 mm (No.4 to 3/4 in.)
Coarse-Grained Sand:	2 mm to 4.75 mm (No.10 to No.4)
Medium-Grained Sand:	0.42 mm to 2 mm (No.40 to No.10)
Fine-Grained Sand:	0.075 mm to 0.42 mm (No. 200 to No.40)
Silt:	0.005 mm to 0.075 mm
Clay:	<0.005 mm

PARTICLE SHAPE

Description	Criteria
Flat:	Particles with width/thickness ratio > 3
Elongated:	Particles with length/width ratio > 3
Flat & Elongated:	Particles meet criteria for both flat and elongated

RELATIVE PROPORTIONS OF FINES

Descriptive Term	% Dry Weight
Trace:	< 5%
With:	5% to 12%
Modifier:	>12%



GENERAL NOTES

(Continued)

CONSISTENCY OF FINE-GRAINED SOILS

<u>Q_u - TSF</u>	<u>N - Blows/foot</u>	<u>Consistency</u>
0 - 0.25	0 - 2	Very Soft
0.25 - 0.50	2 - 4	Soft
0.50 - 1.00	4 - 8	Firm (Medium Stiff)
1.00 - 2.00	8 - 15	Stiff
2.00 - 4.00	15 - 30	Very Stiff
4.00 - 8.00	30 - 50	Hard
8.00+	50+	Very Hard

MOISTURE CONDITION DESCRIPTION

<u>Description</u>	<u>Criteria</u>
Dry:	Absence of moisture, dusty, dry to the touch
Moist:	Damp but no visible water
Wet:	Visible free water, usually soil is below water table

RELATIVE PROPORTIONS OF SAND AND GRAVEL

<u>Descriptive Term</u>	<u>% Dry Weight</u>
Trace:	< 15%
With:	15% to 30%
Modifier:	>30%

STRUCTURE DESCRIPTION

<u>Description</u>	<u>Criteria</u>	<u>Description</u>	<u>Criteria</u>
Stratified:	Alternating layers of varying material or color with layers at least 1/4-inch (6 mm) thick	Blocky:	Cohesive soil that can be broken down into small angular lumps which resist further breakdown
Laminated:	Alternating layers of varying material or color with layers less than 1/4-inch (6 mm) thick	Lensed:	Inclusion of small pockets of different soils
Fissured:	Breaks along definite planes of fracture with little resistance to fracturing	Layer:	Inclusion greater than 3 inches thick (75 mm)
Slickensided:	Fracture planes appear polished or glossy, sometimes striated	Seam:	Inclusion 1/8-inch to 3 inches (3 to 75 mm) thick extending through the sample
		Parting:	Inclusion less than 1/8-inch (3 mm) thick

SCALE OF RELATIVE ROCK HARDNESS

<u>Q_u - TSF</u>	<u>Consistency</u>
2.5 - 10	Extremely Soft
10 - 50	Very Soft
50 - 250	Soft
250 - 525	Medium Hard
525 - 1,050	Moderately Hard
1,050 - 2,600	Hard
>2,600	Very Hard

ROCK BEDDING THICKNESSES

<u>Description</u>	<u>Criteria</u>
Very Thick Bedded	Greater than 3-foot (>1.0 m)
Thick Bedded	1-foot to 3-foot (0.3 m to 1.0 m)
Medium Bedded	4-inch to 1-foot (0.1 m to 0.3 m)
Thin Bedded	1 1/4-inch to 4-inch (30 mm to 100 mm)
Very Thin Bedded	1/2-inch to 1 1/4-inch (10 mm to 30 mm)
Thickly Laminated	1/8-inch to 1/2-inch (3 mm to 10 mm)
Thinly Laminated	1/8-inch or less "paper thin" (<3 mm)

ROCK VOIDS

<u>Voids</u>	<u>Void Diameter</u>
Pit	<6 mm (<0.25 in)
Vug	6 mm to 50 mm (0.25 in to 2 in)
Cavity	50 mm to 600 mm (2 in to 24 in)
Cave	>600 mm (>24 in)

GRAIN-SIZED TERMINOLOGY

<u>(Typically Sedimentary Rock)</u>	
<u>Component</u>	<u>Size Range</u>
Very Coarse Grained	>4.76 mm
Coarse Grained	2.0 mm - 4.76 mm
Medium Grained	0.42 mm - 2.0 mm
Fine Grained	0.075 mm - 0.42 mm
Very Fine Grained	<0.075 mm

ROCK QUALITY DESCRIPTION

<u>Rock Mass Description</u>	<u>RQD Value</u>
Excellent	90 - 100
Good	75 - 90
Fair	50 - 75
Poor	25 - 50
Very Poor	Less than 25

Slightly Weathered: Rock generally fresh, joints stained and discoloration extends into rock up to 25 mm (1 in), open joints may contain clay, core rings under hammer impact.

Weathered: Rock mass is decomposed 50% or less, significant portions of the rock show discoloration and weathering effects, cores cannot be broken by hand or scraped by knife.

Highly Weathered: Rock mass is more than 50% decomposed, complete discoloration of rock fabric, core may be extremely broken and gives clunk sound when struck by hammer, may be shaved with a knife.



SOIL CLASSIFICATION CHART

NOTE: DUAL SYMBOLS ARE USED TO INDICATE BORDERLINE SOIL CLASSIFICATIONS

MAJOR DIVISIONS			SYMBOLS		TYPICAL DESCRIPTIONS
			GRAPH	LETTER	
COARSE GRAINED SOILS MORE THAN 50% OF MATERIAL IS LARGER THAN NO. 200 SIEVE SIZE	GRAVEL AND GRAVELLY SOILS MORE THAN 50% OF COARSE FRACTION RETAINED ON NO. 4 SIEVE	CLEAN GRAVELS (LITTLE OR NO FINES)		GW	WELL-GRADED GRAVELS, GRAVEL - SAND MIXTURES, LITTLE OR NO FINES
				GP	POORLY-GRADED GRAVELS, GRAVEL - SAND MIXTURES, LITTLE OR NO FINES
		GRAVELS WITH FINES (APPRECIABLE AMOUNT OF FINES)		GM	SILTY GRAVELS, GRAVEL - SAND - SILT MIXTURES
				GC	CLAYEY GRAVELS, GRAVEL - SAND - CLAY MIXTURES
	SAND AND SANDY SOILS MORE THAN 50% OF COARSE FRACTION PASSING ON NO. 4 SIEVE	CLEAN SANDS (LITTLE OR NO FINES)		SW	WELL-GRADED SANDS, GRAVELLY SANDS, LITTLE OR NO FINES
				SP	POORLY-GRADED SANDS, GRAVELLY SAND, LITTLE OR NO FINES
		SANDS WITH FINES (APPRECIABLE AMOUNT OF FINES)		SM	SILTY SANDS, SAND - SILT MIXTURES
				SC	CLAYEY SANDS, SAND - CLAY MIXTURES
FINE GRAINED SOILS MORE THAN 50% OF MATERIAL IS SMALLER THAN NO. 200 SIEVE SIZE	SILTS AND CLAYS LIQUID LIMIT LESS THAN 50			ML	INORGANIC SILTS AND VERY FINE SANDS, ROCK FLOUR, SILTY OR CLAYEY FINE SANDS OR CLAYEY SILTS WITH SLIGHT PLASTICITY
				CL	INORGANIC CLAYS OF LOW TO MEDIUM PLASTICITY, GRAVELLY CLAYS, SANDY CLAYS, SILTY CLAYS, LEAN CLAYS
				OL	ORGANIC SILTS AND ORGANIC SILTY CLAYS OF LOW PLASTICITY
	SILTS AND CLAYS LIQUID LIMIT GREATER THAN 50			MH	INORGANIC SILTS, MICACEOUS OR DIATOMACEOUS FINE SAND OR SILTY SOILS
				CH	INORGANIC CLAYS OF HIGH PLASTICITY
				OH	ORGANIC CLAYS OF MEDIUM TO HIGH PLASTICITY, ORGANIC SILTS
HIGHLY ORGANIC SOILS				PT	PEAT, HUMUS, SWAMP SOILS WITH HIGH ORGANIC CONTENTS



APPENDIX F – DRILL, FIELD AND LAB TESTING PROCEDURES



Drilling and Sampling Procedures

The soil borings were performed with a truck-mounted rotary head drill rig. Borings were advanced using 3¼-inch inside diameter hollow-stem augers. Representative samples were obtained employing split-spoon and thin-wall tube sampling procedures in general accordance with ASTM procedures.

Field Tests and Measurements

Penetration Tests and Split-Barrel Sampling of Soils

During the sampling procedure, Standard Penetration Tests (SPT) were performed at regular intervals (2½-foot intervals to 10 feet and 5-foot intervals thereafter) to obtain the standard penetration value (N) of the soil. The results of the standard penetration test indicate the relative density and comparative consistency of the soils, and thereby provide a basis for estimating the relative strength and compressibility of the soil profile components. The split-barrel sampler provides a soil sample for identification purposes and for laboratory tests appropriate for soil obtained from a sampler that may produce large shear strain while obtaining the sample.

Thin-Walled (Shelby) Tube Geotechnical Sampling of Soils

Thin-walled tube samples are utilized to obtain a relatively undisturbed specimen suitable for laboratory tests of structural properties or other tests that might be influenced by soil properties. A relatively undisturbed sample is obtained by pressing a thin-walled metal tube (typically an outside diameter 3 inches) into the in-situ soil, removing the soil-filled tube, and sealing the ends to reduce the soil disturbance or moisture loss. These samples may be utilized in the laboratory to obtain the following information or perform the following tests: Unconfined Compressive Strength (q_u), Laboratory Determination of Water Content, Wet and Dry Density, Percent Saturation, and Atterberg Limits

Water Level Measurements

Water level observations were attempted during and upon completion of the drilling operation using a 100-foot tape measure. The depths of observed water levels in the boreholes are noted on the boring logs presented in the appendix of this report. In the borings where water was unable to be observed during the field activities, in relatively impervious soils, the accurate determination of the groundwater elevation may not be possible even after several days of observation. Seasonal variations, temperature and recent rainfall conditions may influence the levels of the groundwater table and volumes of water will depend on the permeability of the soils.

Laboratory Testing Program

In addition to the field exploration, a supplemental laboratory-testing program was conducted to determine additional engineering characteristics of the foundation materials necessary in analyzing the behavior of the soils as it relates to the construction of the proposed structures. The laboratory testing program is as follows:

Laboratory Determination of Water (Moisture) Content of Soil by Mass

The water content is a significant index property used in establishing a correlation between soil behavior and its index properties. The water content is used in expressing the phase relationship of air, water, and solids in a given volume of material. In fine grained cohesive soils, the behavior of a given soil type often depends on its water content. The water content of a soil along with its liquid and plastic limits as determined by Atterberg Limit testing, is used to express its relative consistency or liquidity index.

Atterberg Limits

The Atterberg Limits are defined by the liquid limit (LL) and plastic limit (PL) states of a given soil. These limits are used to determine the moisture content limits where the soil characteristics changes from behaving more like a fluid on the liquid limit end to where the soil behaves more like individual soil particles on the plastic limit end. The liquid limit is often used to indicate if a soil is a low or high plasticity soil. The plasticity index (PI) is difference between the liquid limit and the plastic limit. The plasticity index is used in conjunction with the liquid limit to assess if the material will behave like a silt or clay. The material can also be classified as an organic material by comparing the liquid limit of the natural material to the liquid limit of the sample after being oven-dried.



Unconfined Compressive Strength of Cohesive Soil (q_u)

The primary purpose of the unconfined compressive strength test is to obtain the undrained compressive strength of soils that possess sufficient cohesion to permit testing in the unconfined state. Unconfined compressive strength (q_u) is the compressive stress at which an unconfined cylindrical specimen of soil will fail in a simple compression test. In this test method, unconfined compressive strength is taken as the maximum load obtained per unit area or the load per unit area at 15% axial strain, whichever is obtained first during the performance of a test. For the unconfined compressive strength test, the shear strength (s_u) is calculated to be half of the compressive stress at failure.